


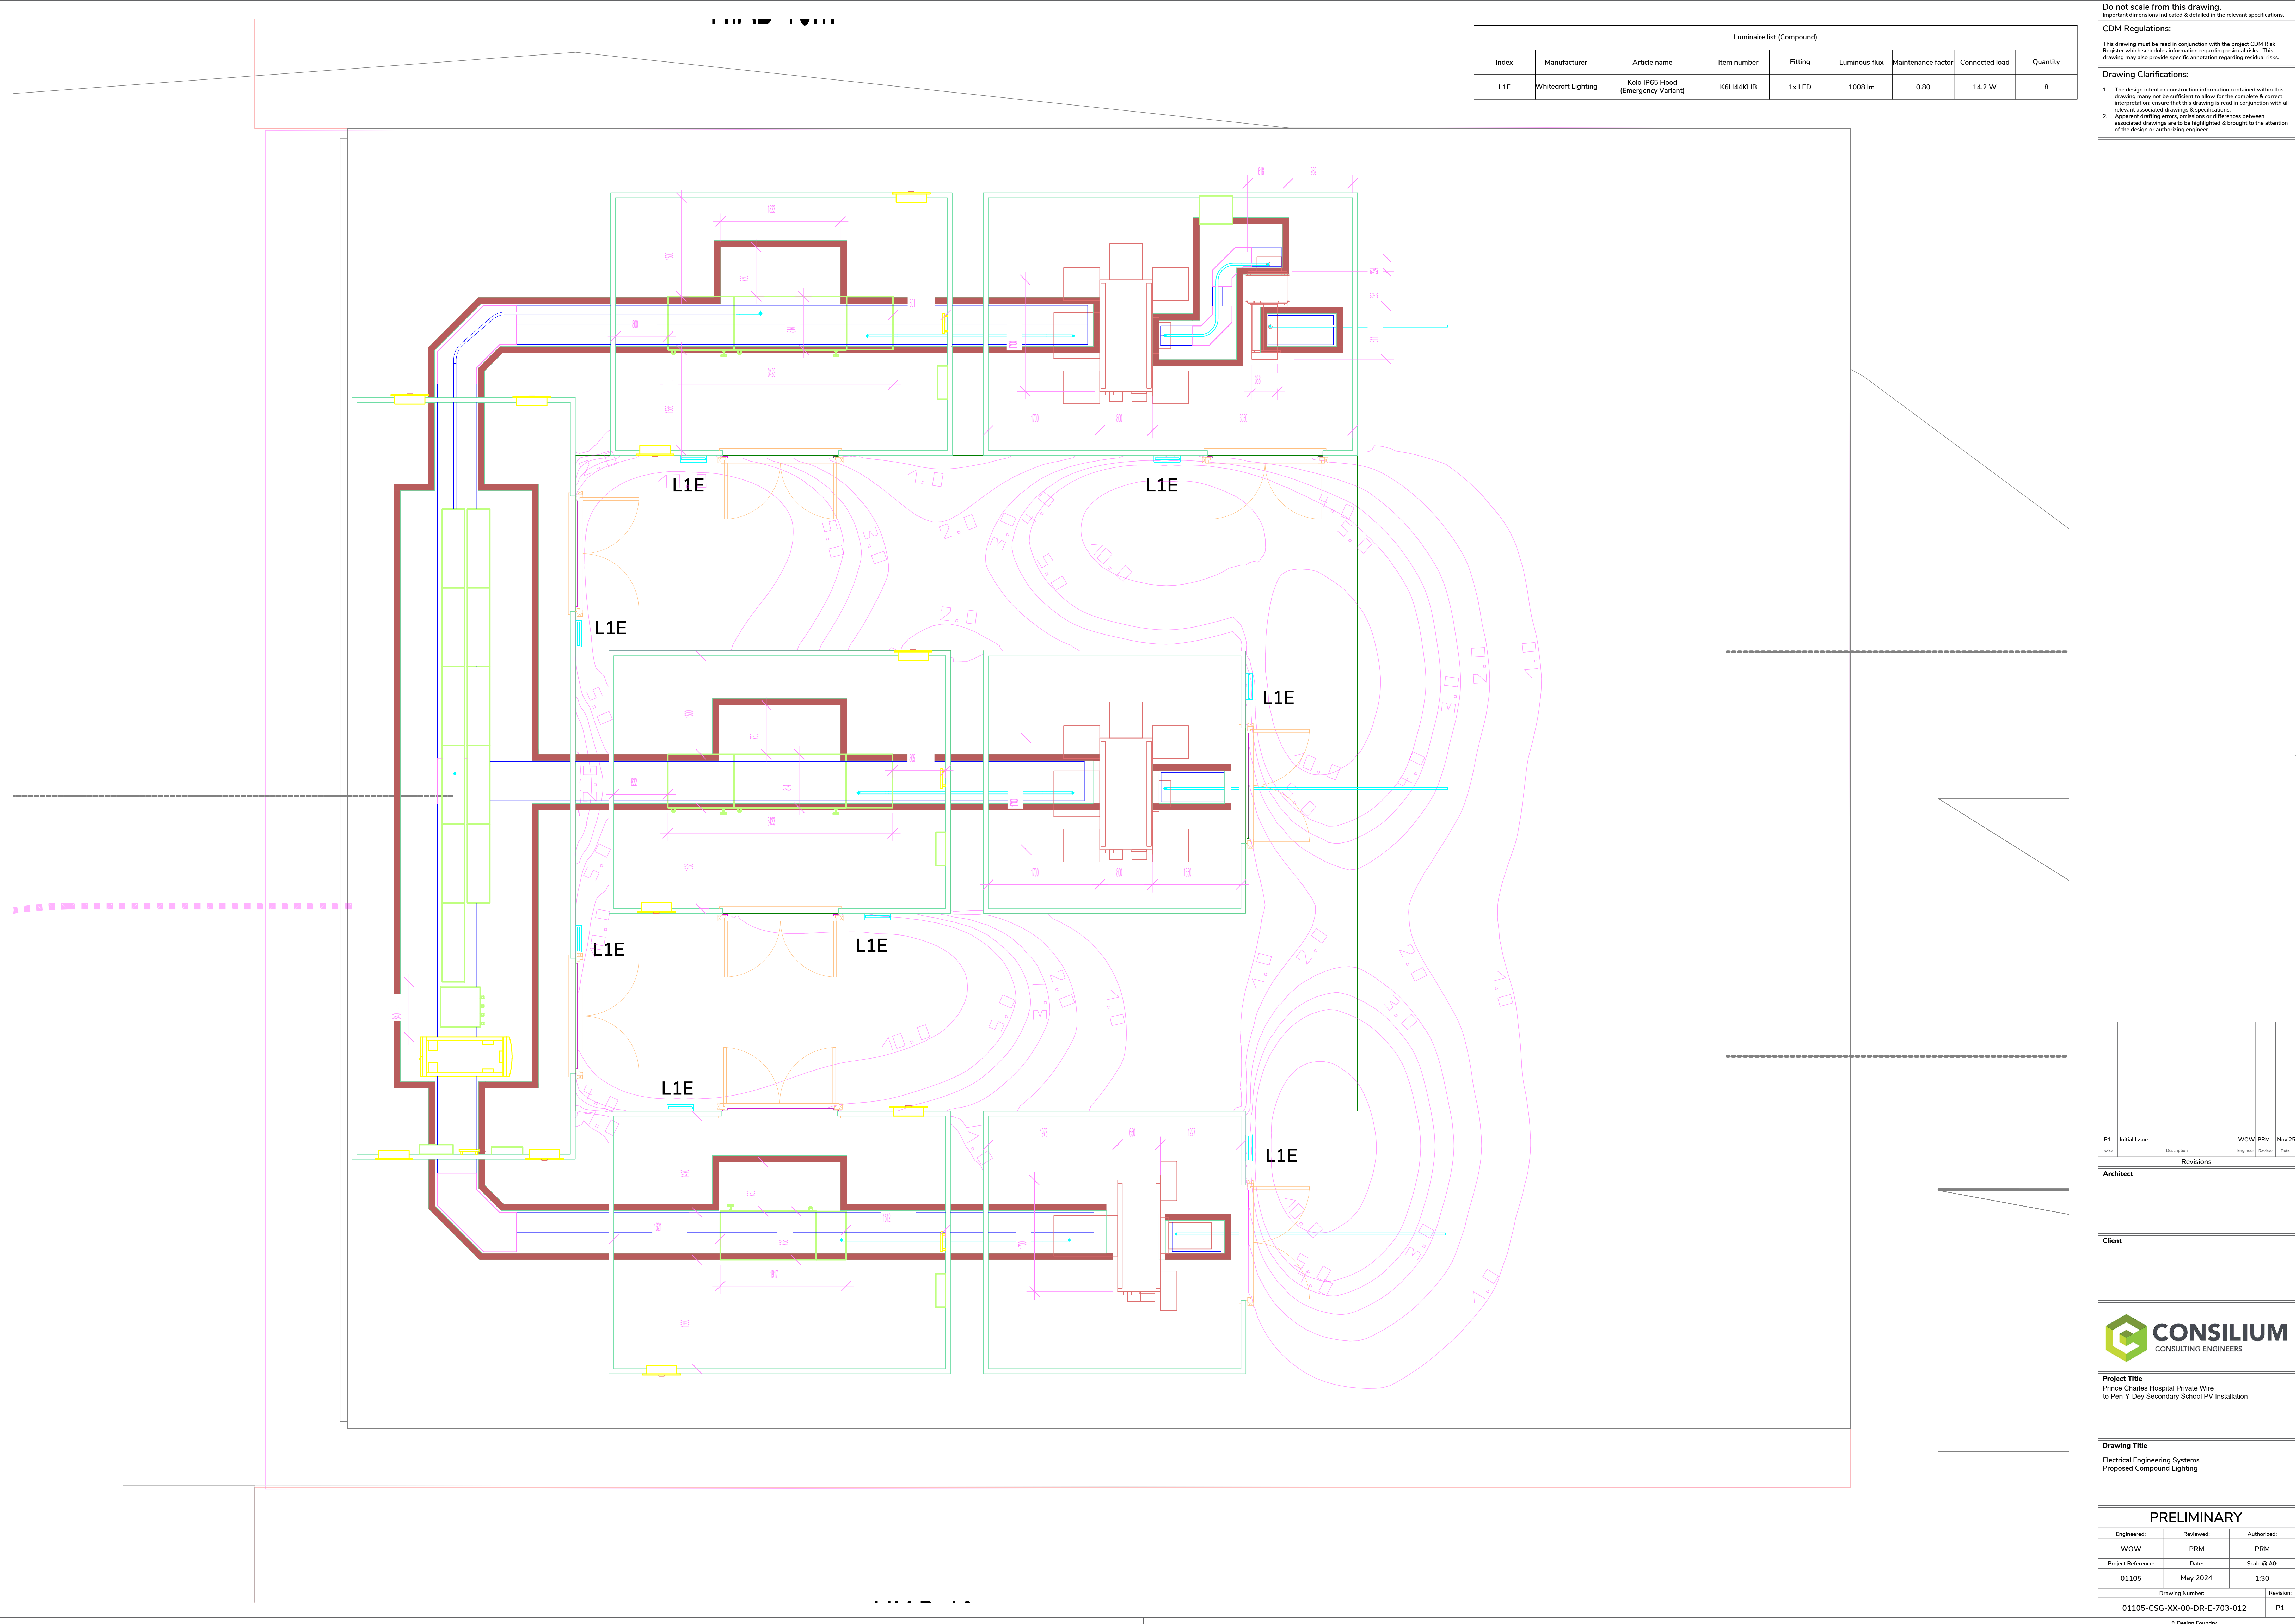

Luminaire list (Compound)								
Index	Manufacturer	Article name	Item number	Fitting	Luminous flux	Maintenance factor	Connected load	Quantity
L1E	Whitcroft Lighting	Kole IP65 Hood (Emergency Variant)	K6H44KHB	1x LED	1008 lm	0.80	14.2 W	8

Do not scale from this drawing.
Important dimensions indicated & detailed in the relevant specifications.

CDM Regulations:
This drawing must be read in conjunction with the project CDM Risk Register which schedules information regarding residual risks. This drawing may also provide specific annotation regarding residual risks.

Drawing Clarifications:
1. The design intent or construction information contained within this drawing may not be sufficient to allow for the complete & correct interpretation; ensure that this drawing is read in conjunction with all relevant associated drawings & specifications.
2. Apparent drafting errors, omissions or differences between associated drawings are to be highlighted & brought to the attention of the design or authorizing engineer.

Index	Initial Issue	Description	Engineer	Review	Date
P1	Initial Issue		WOW/PRM	Nov25	

Revisions					
Index	Revised	Description	Engineer	Review	Date

Architect

Client



Project Title
Prince Charles Hospital Private Wire to Pen-Y-Dry Secondary School PV Installation

Drawing Title
Electrical Engineering Systems
Proposed Compound Lighting

PRELIMINARY

Engineered:	Reviewed:	Authorized:
WOW	PRM	PRM
Project Reference:	Date:	Scale @ A0:
01105	May 2024	1:30
Drawing Number:		Revisions
01105-CSG-XX-00-DR-E-703-012		P1