
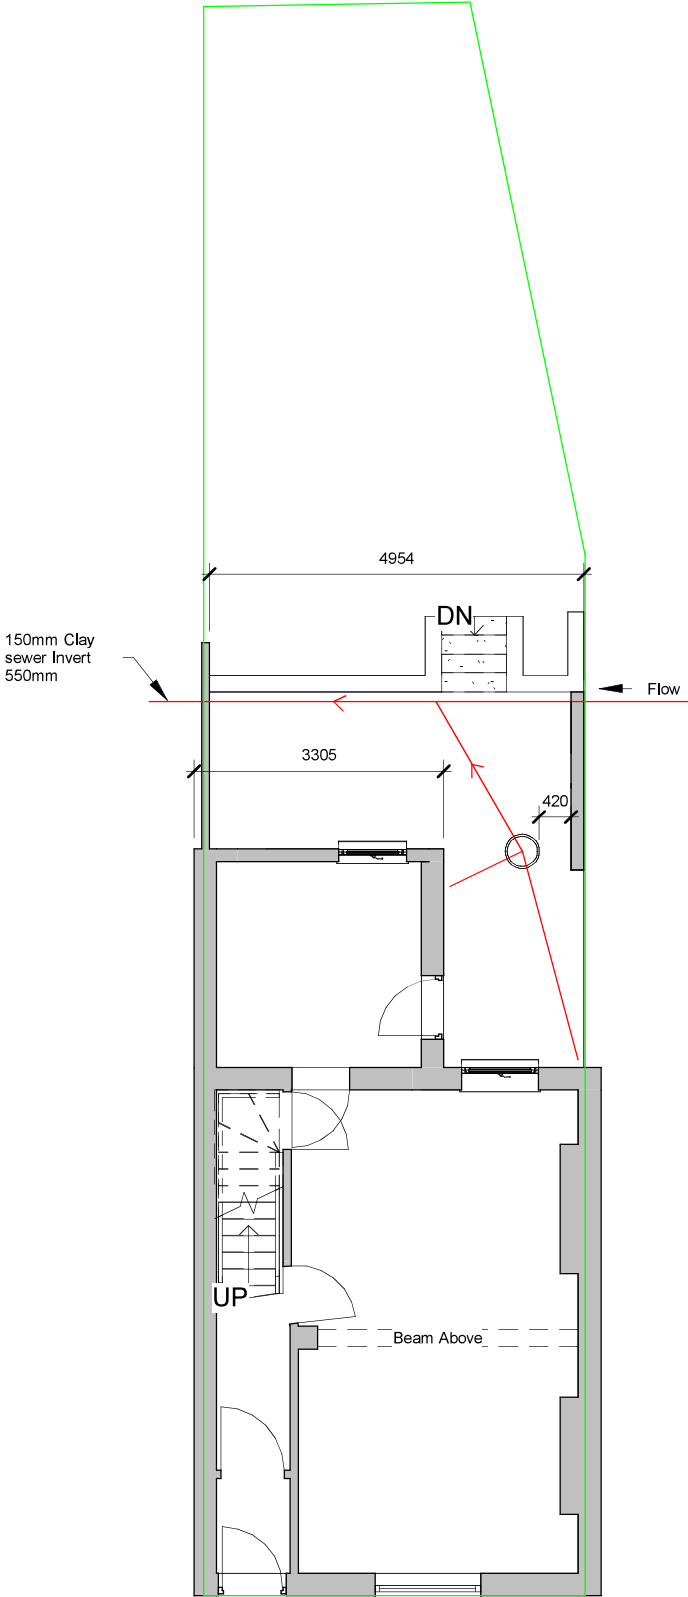


Contractor to be SSIP accredited.


Sewer Protection
New foundations will be a minimum of 150mm below invert level.

NOTE:
"The developer must self-vet and certify that the design criteria, material standards and workmanship specifications for the proposed adoptable sewers are in accordance with those set out in Sewers for Adoption 7th Edition, The Welsh Ministers standards and the requirements of us (DCWW) as the Statutory Sewerage Undertaker." 100mm diameter plastic pipe shall comply with the relevant provisions of BS EN 1401-1, BS EN 1852 and BS EN 12666-1 and be kite marked. Thermoplastic chambers and rings shall comply with BS EN 13598-1 and BS EN 13598-2 and be kite marked. Contractor to be SSIP accredited.

PIPES PASSING THROUGH WALL (LINTEL)

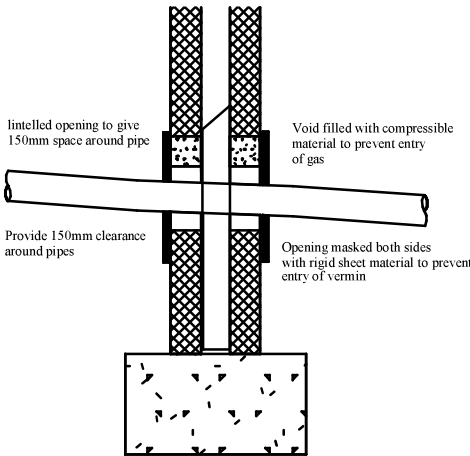

1 Existing Drain Plan
1 : 100

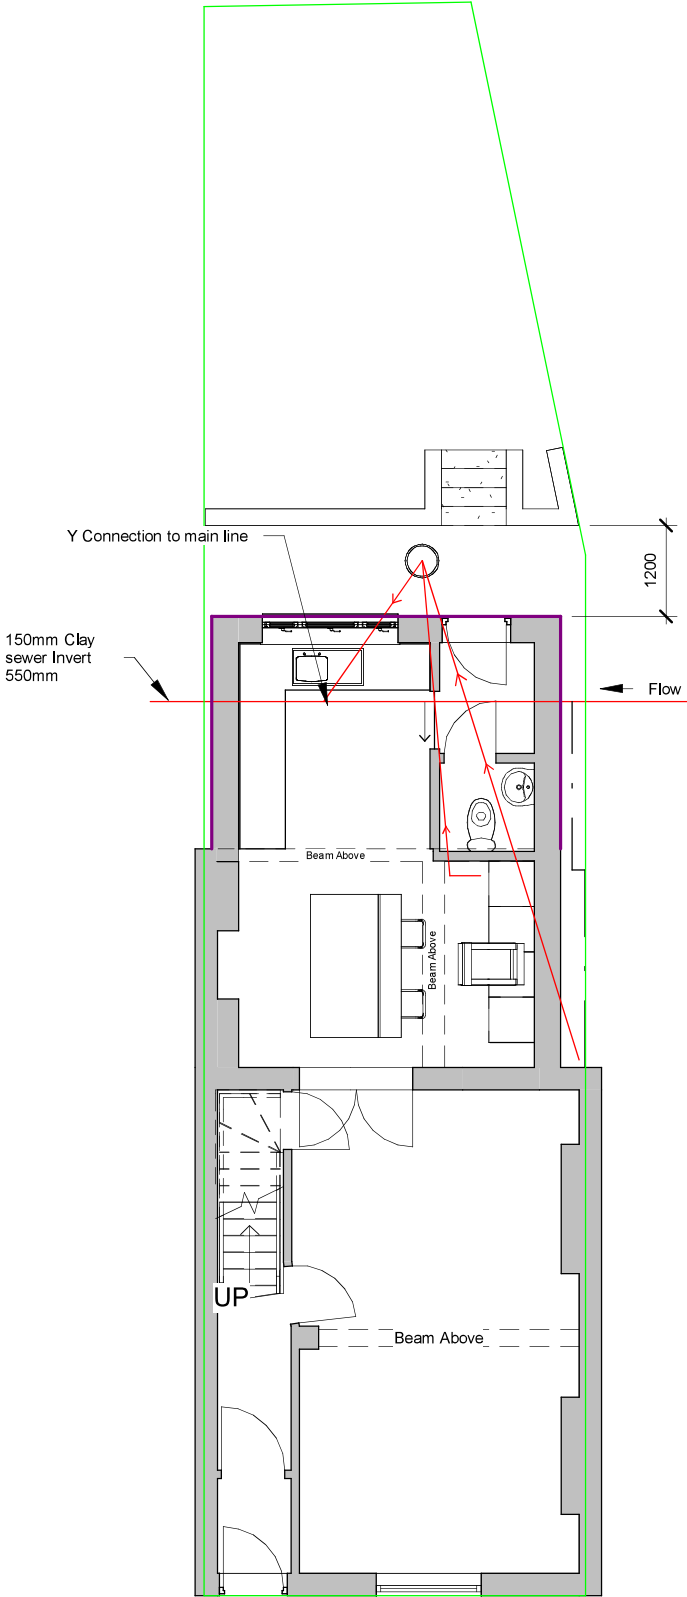

2 Proposed Drain Plan
1 : 100

INDIGO DESIGN (Part of 3dcadwales Ltd) 5 Ashlea Drive,
Merthyr Tydfil, CF47 0NY Tele 01685 385746 Mob -
07940913216 Email: philip@3dcadwales.co.uk

This Drawing is Copyright.
Dimensions to be checked
on site and not scaled from
this drawing



PURPOSE OF ISSUE

DRWAING NUMBER

Planning Approval

MT-04

PROJECT

Single storey extension to rear

SHEET

Drain Plans

Address

19 Muriel Terrace, Dowlais, Merthyr
Tydfil.

Checked by

JH

Drawn by

PH

Scale (@ A3)

As indicated

Rev No	Description	Date
A	Issue	16/01/2025