

2.

PLAYING COMMITMENT


19 FEB 2021

11

Cavity Wall :

Face Bwk. to match
existing.
50 mm. Cavity
100 mm. Conc. Bl.

WERTHY TRUFF
COUNTY BROUGH
COUNCIL
OFFICE COPY
PLEASE DO NOT
REMOVE

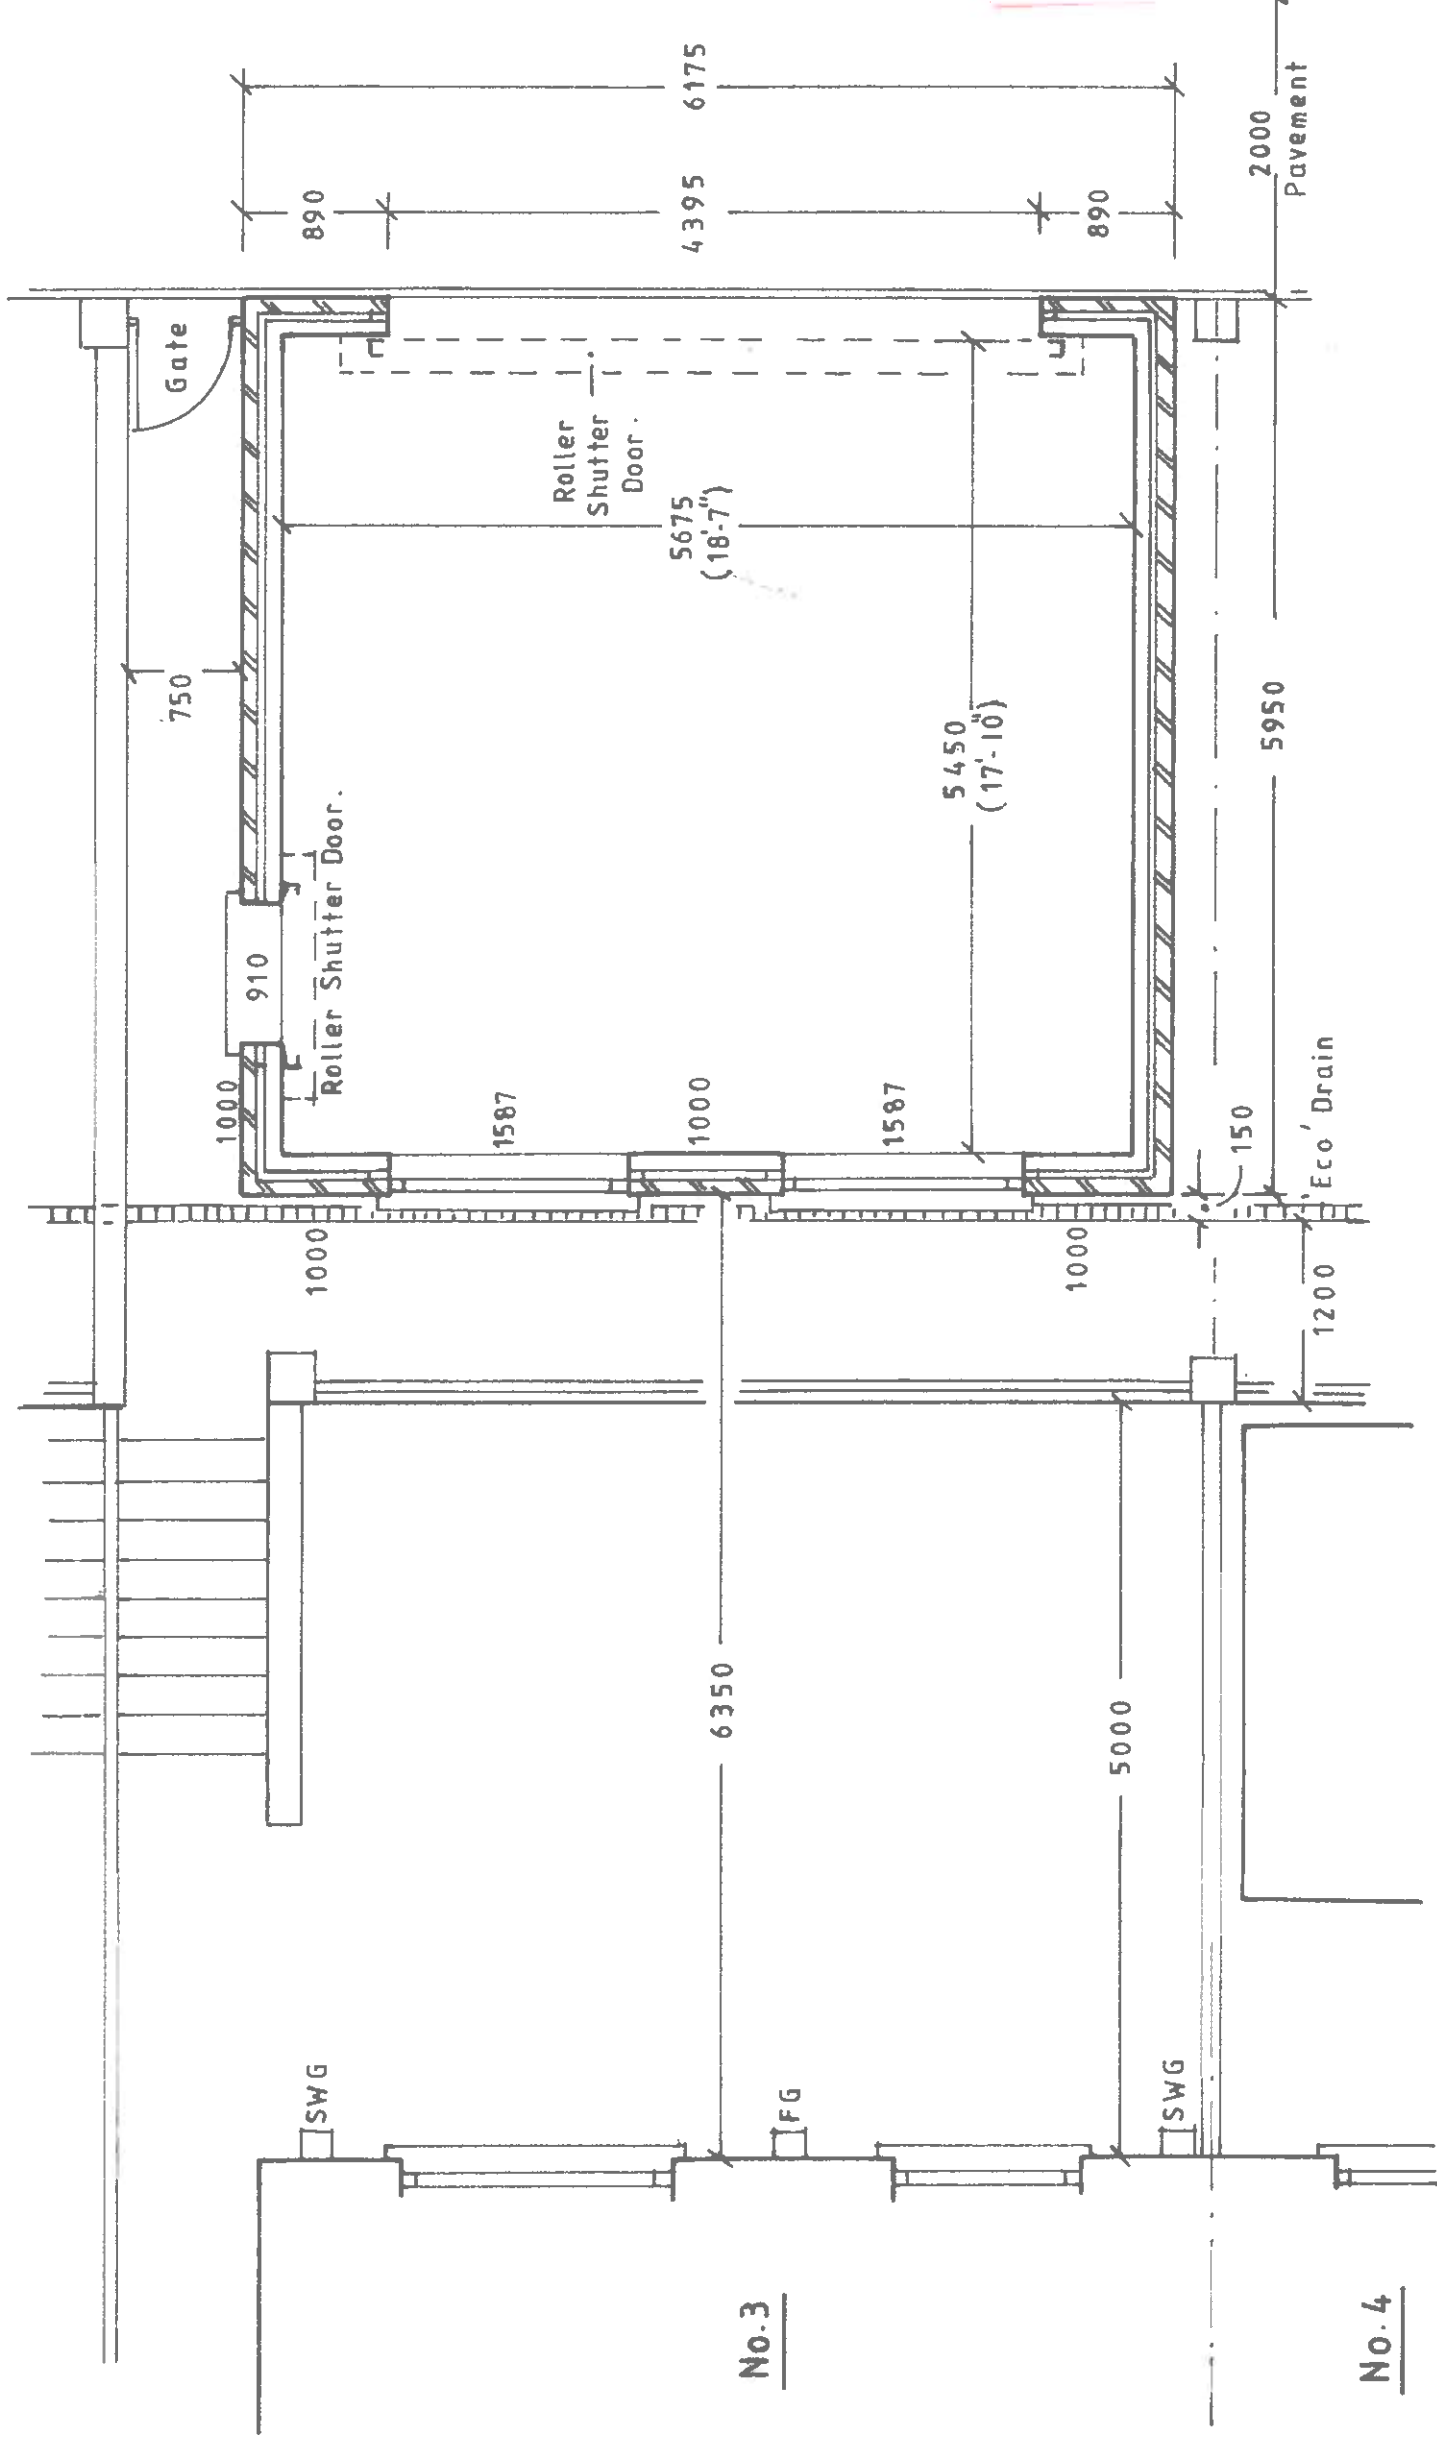

All **lintels** to have minimum end bearing of 150 mm., unless otherwise stated.

All Electrical Work to comply with Part P (Electrical Safety) and the work carried out by a competent person. Certificate issued on completion.

Drainage : Rainwater downpipes to discharge into existing ‘Eco’ drain or into Gulleys connected to existing surface water drain at lower yard level.

IG Lintels L1/S 50 : Front Door - Length 4.8 m.
Windows - Length 1.95 m.
Side Door - Length 1.35 m.

PROPOSED GARAGE. SCALE: 1 / 50.

Sheet 2 of 4.