
Schedule						
Symbol	Label	Quantity	Catalog Number	Description	Lumens Per Lamp	Wattage
	A	3	DSX0.1.LA044.FW.BLS	D-Series 0 Area luminaire c/w back light sheild - Column Mounted @ 4m	3143	29

Statistics				
Description	Symbol	Avg	Min	Min/Avg
Car Park	+	16 lux	5 lux	0.31
Footbridge & Surrounding Area	+	14 lux	6 lux	0.43
Spill Lighting	+	0 lux	0 lux	N/A

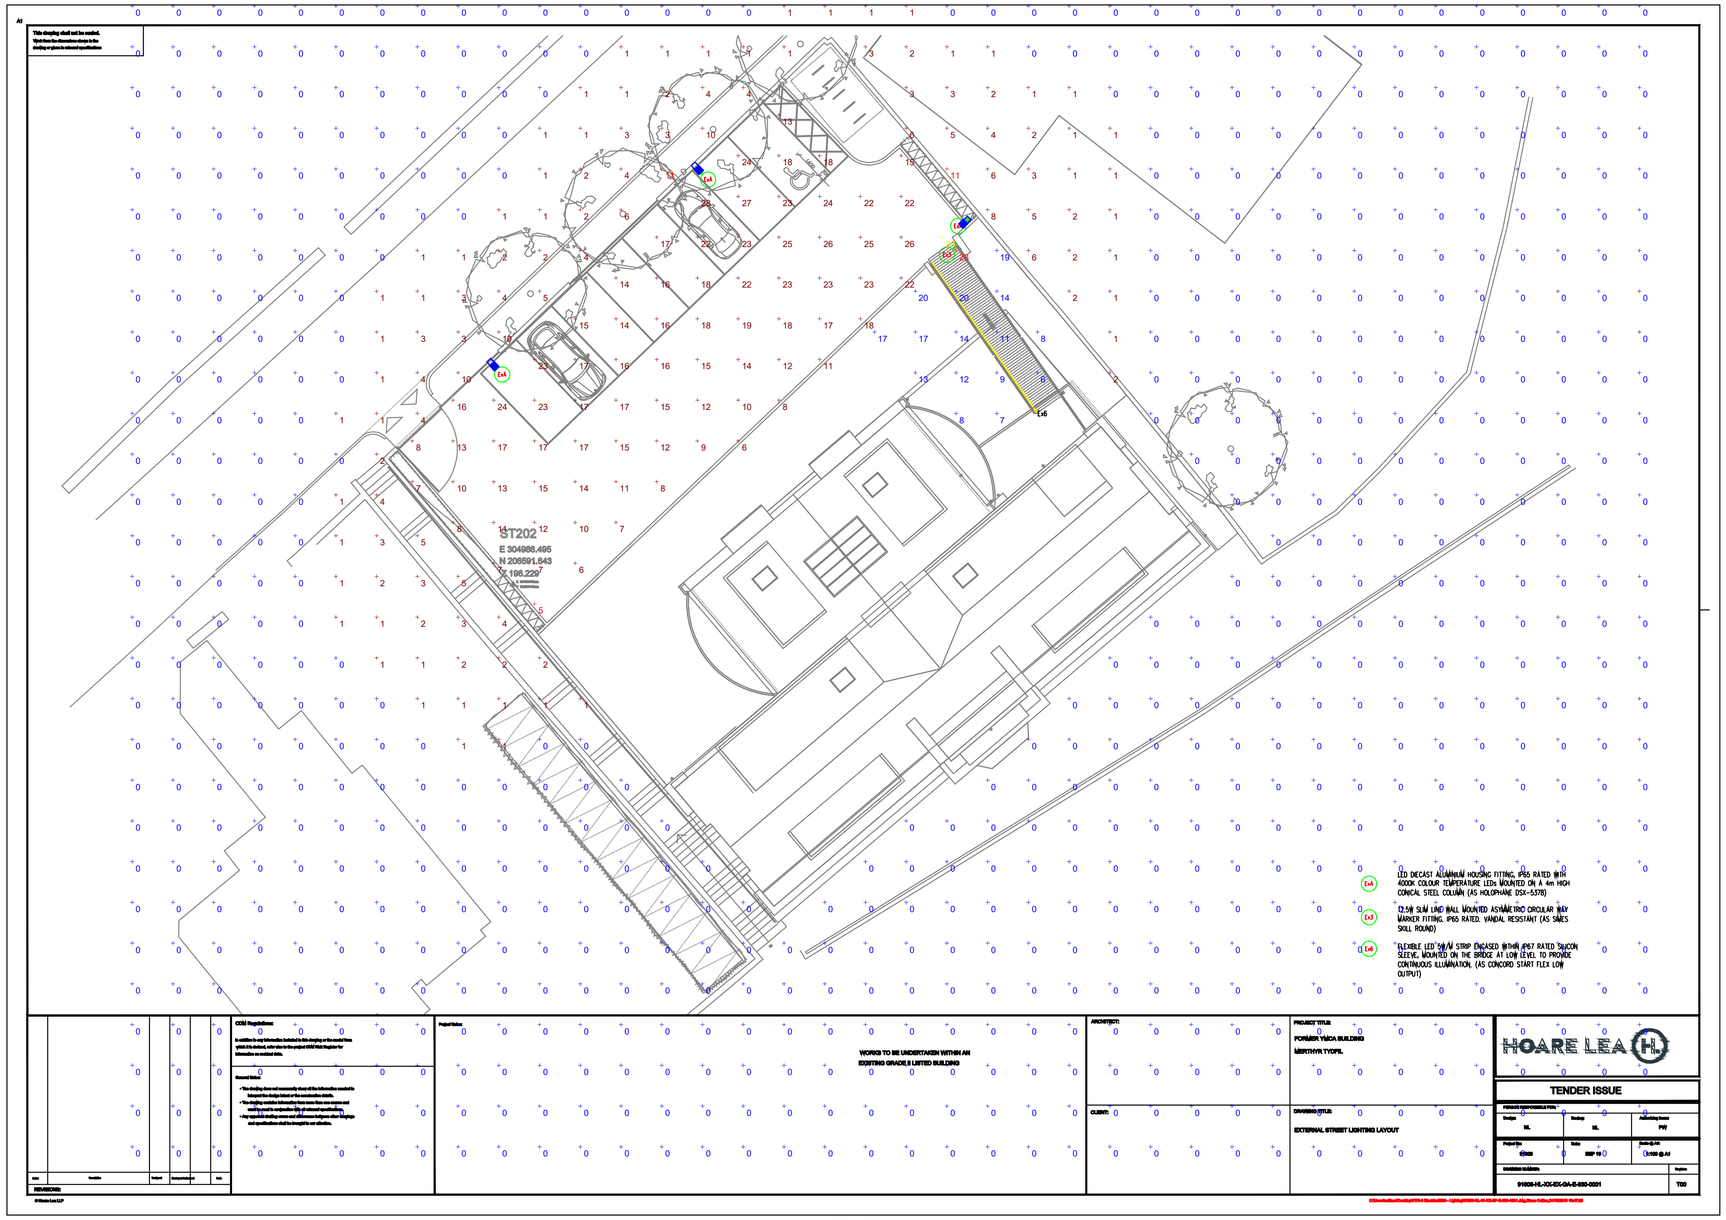

Plan View
Scale - 1 : 150

Former YMCA - Merthyr Tydfil
DSX Option

Designer
Matthew Walton
Date
14/01/2022
Scale
Not to Scale
Drawing No.

Note

Holophane Europe Ltd offer a Lighting Design Service in good faith and without charge, every effort is made to ensure we interpret the design specification accurately. All illuminance values shown are the result of theoretical computer calculations; summated by luminaires positioned in a fixed relationship to each other and the statistical zone. In practice the values may vary due to tolerances in column installation, luminaire orientation, surface reflectance and fluctuations in power supply (voltage).Results provided within this design are derived from product specific photometry, the substitution of alternative luminaires will not produce comparable results.