



- Notes:**
1. Drawings must not be scaled and any discrepancies must be reported immediately.
 2. The drawing is to be read in conjunction with all other relevant project drawings and schedules.
 3. Dimensions indicated are structural.
 4. Drawing must be printed in colour to ensure all elements are clearly identified.

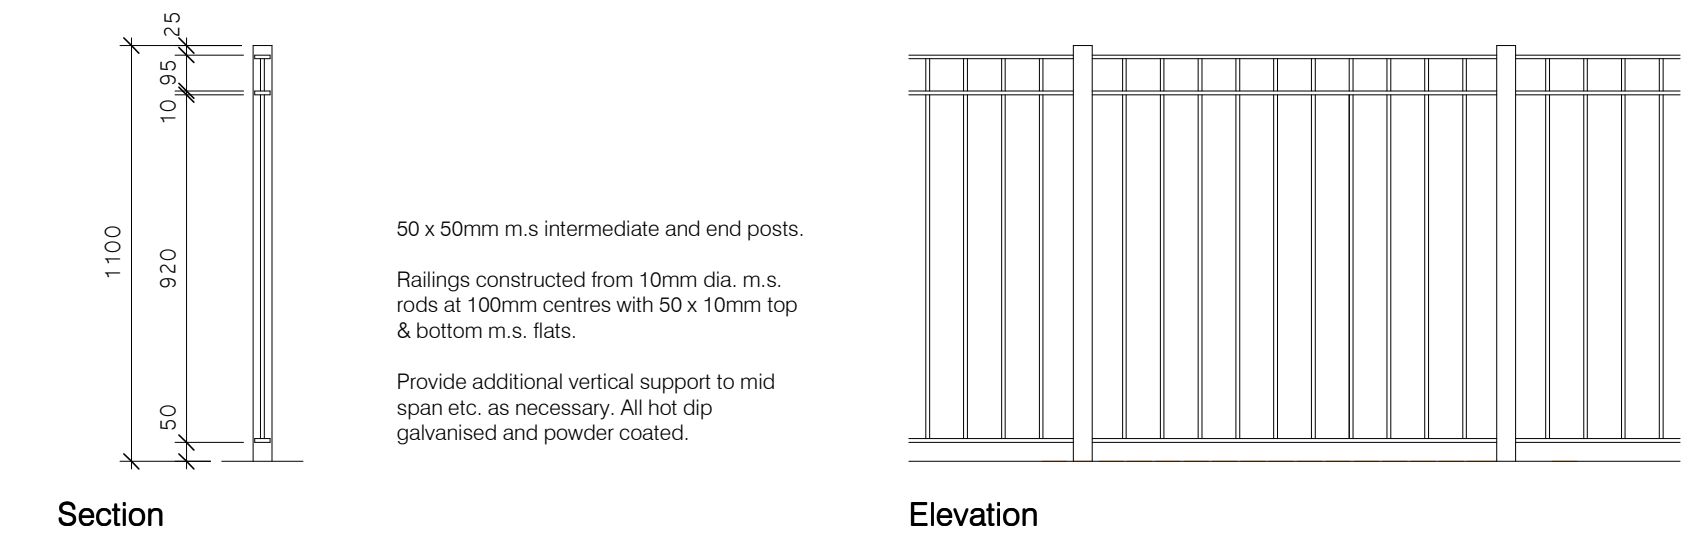

Section

Boundary Type 01


Min. 1100mm high galvanised powder coated steel railings

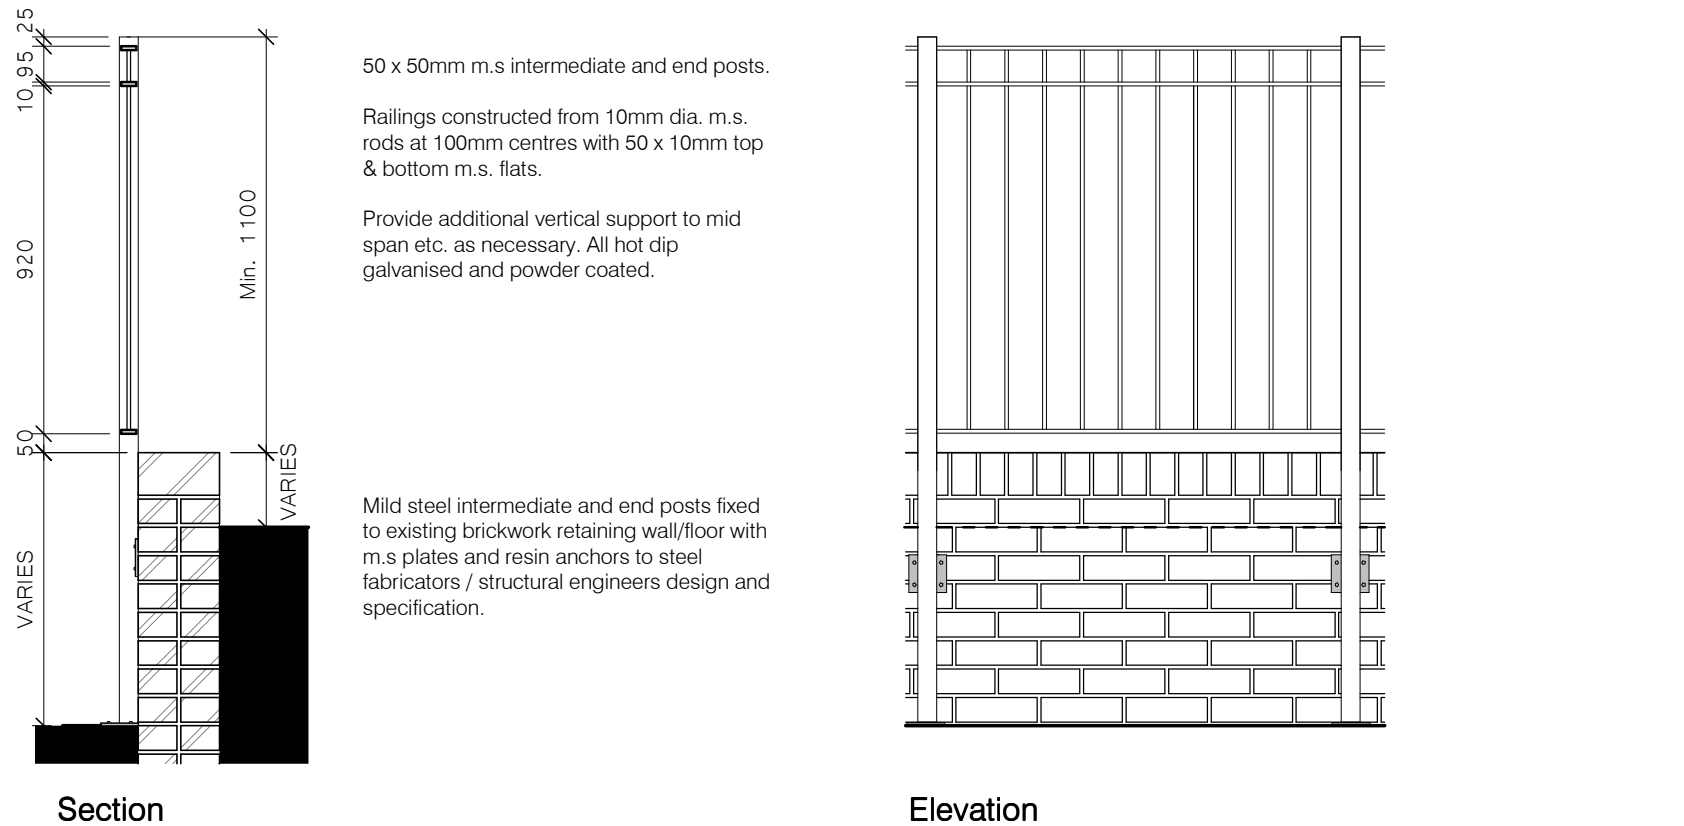

Section

Boundary Type 02


Existing retaining brickwork walls and Min. 1100mm high galvanised powder coated steel railing.

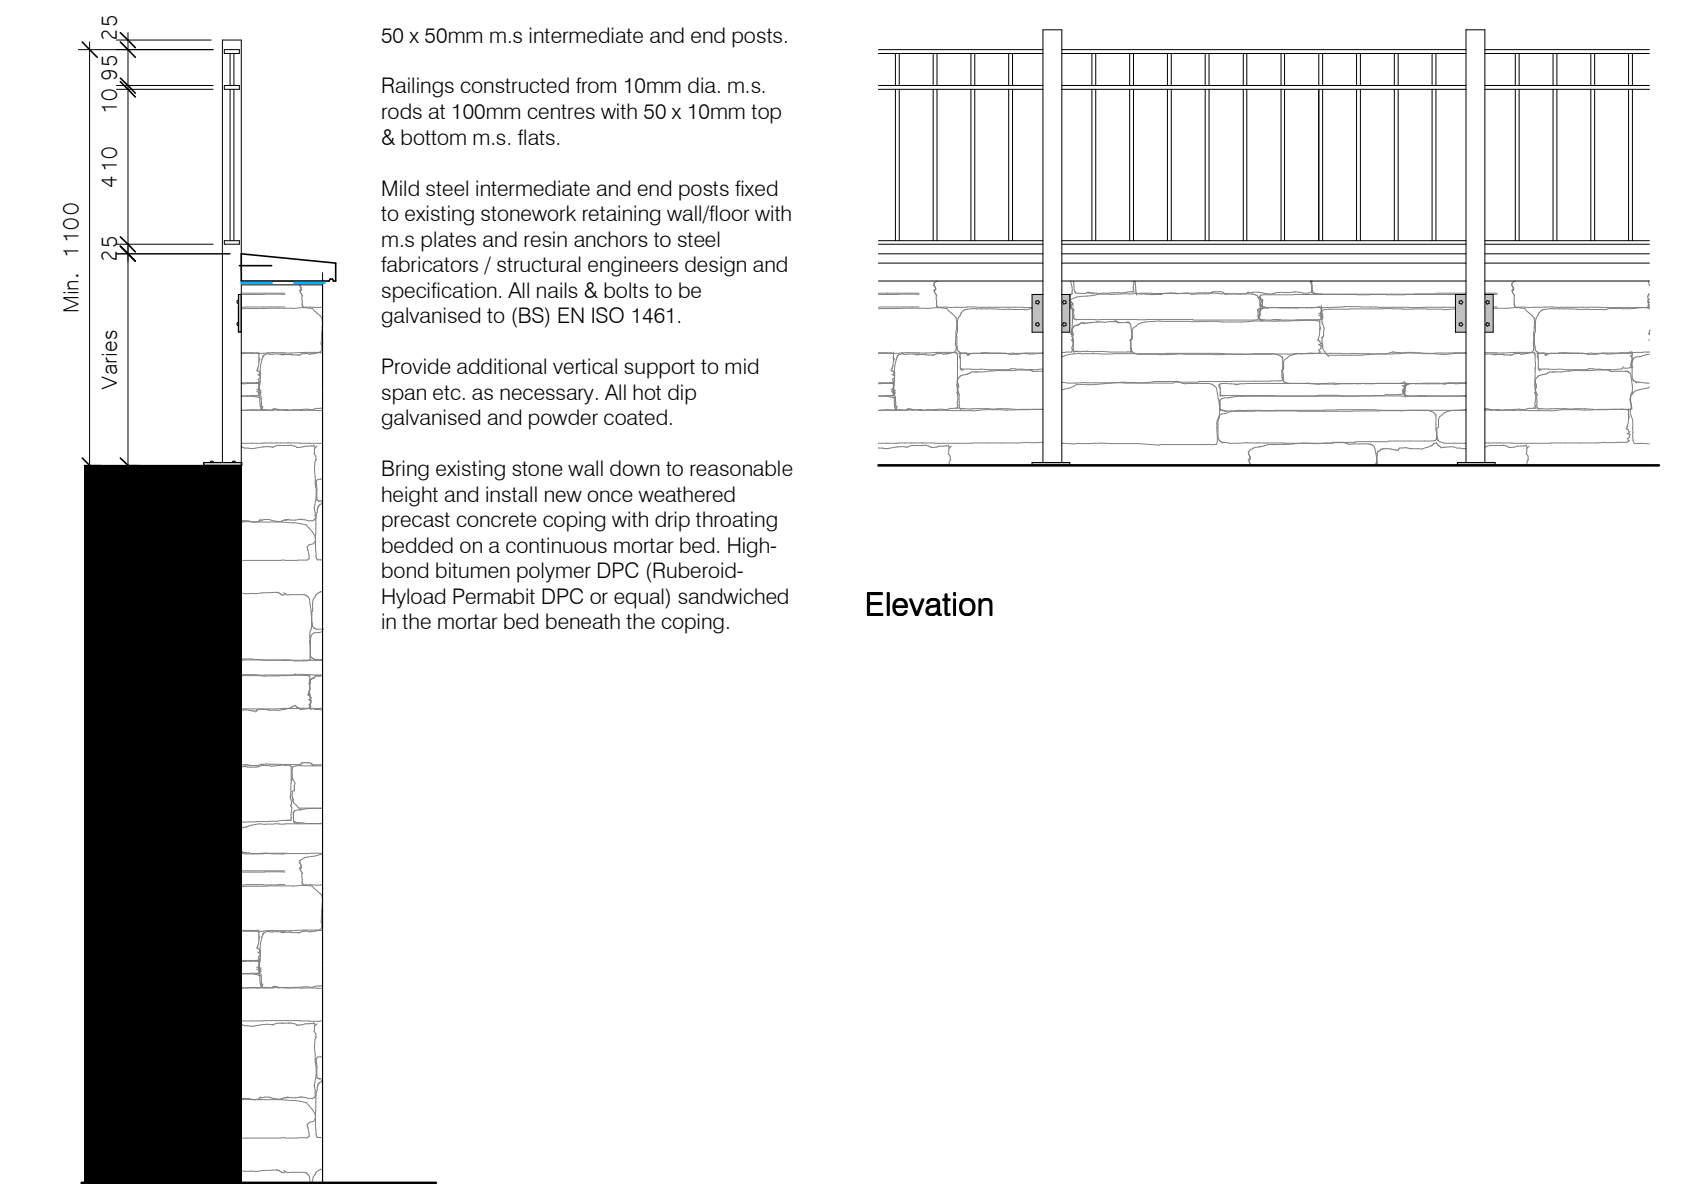

Section

Boundary Type 03


Min. 1100mm high galvanised powder coated steel railings ontop of existing stone wall.

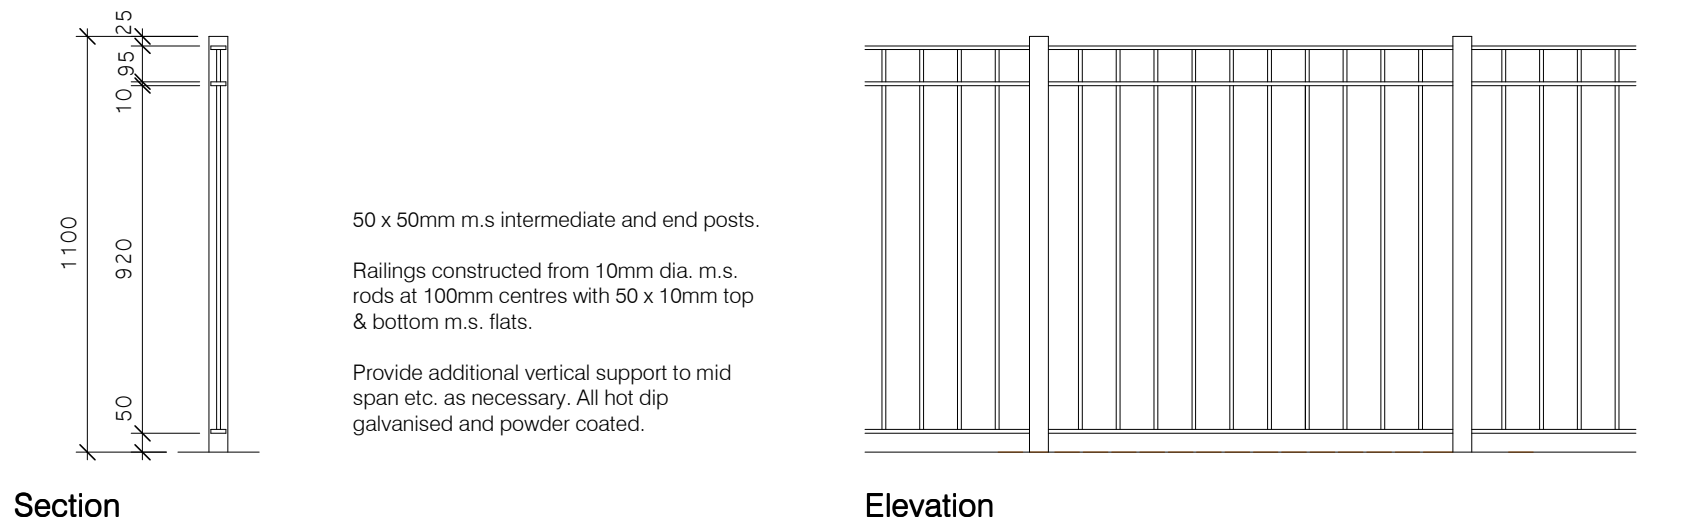

Section

Boundary Type 04


Min. 1100mm high galvanised powder coated steel railings

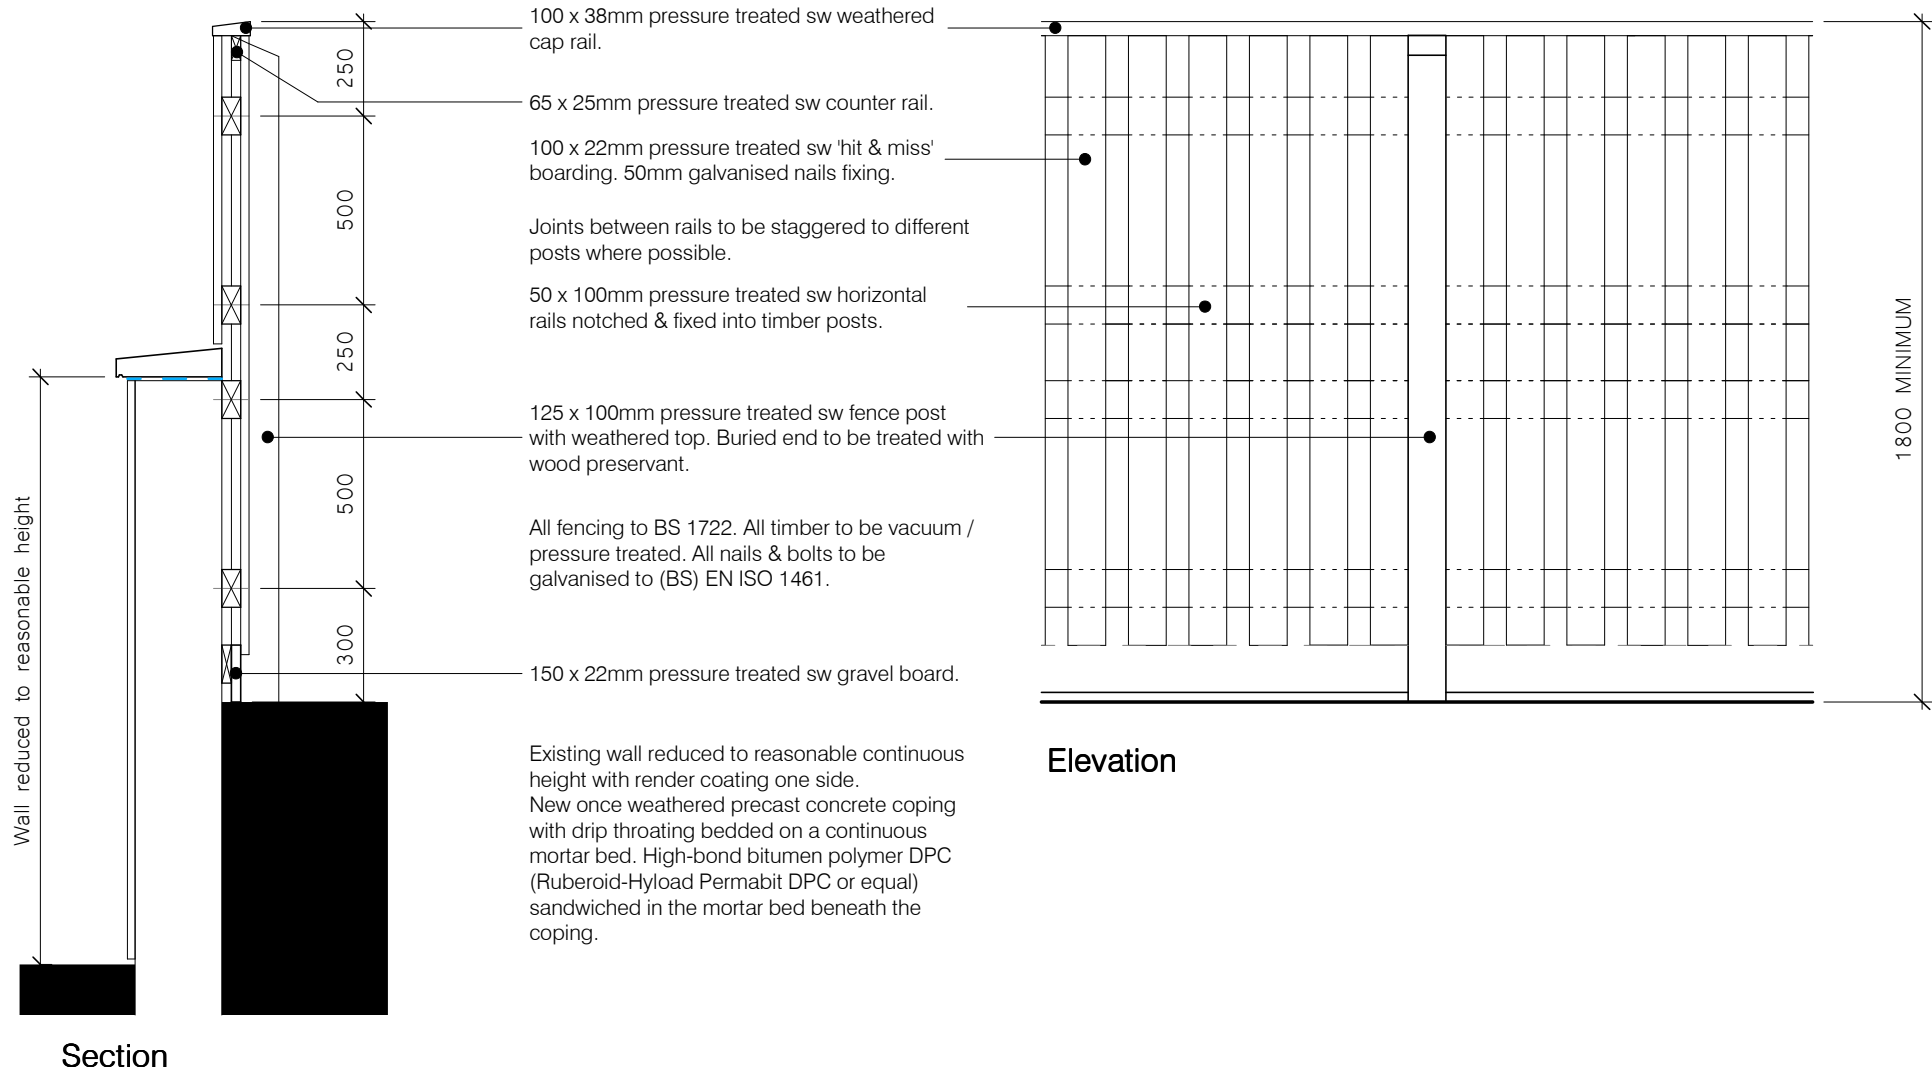

Section

Boundary Type 05


New Fence atop of existing wall 2100mm high.

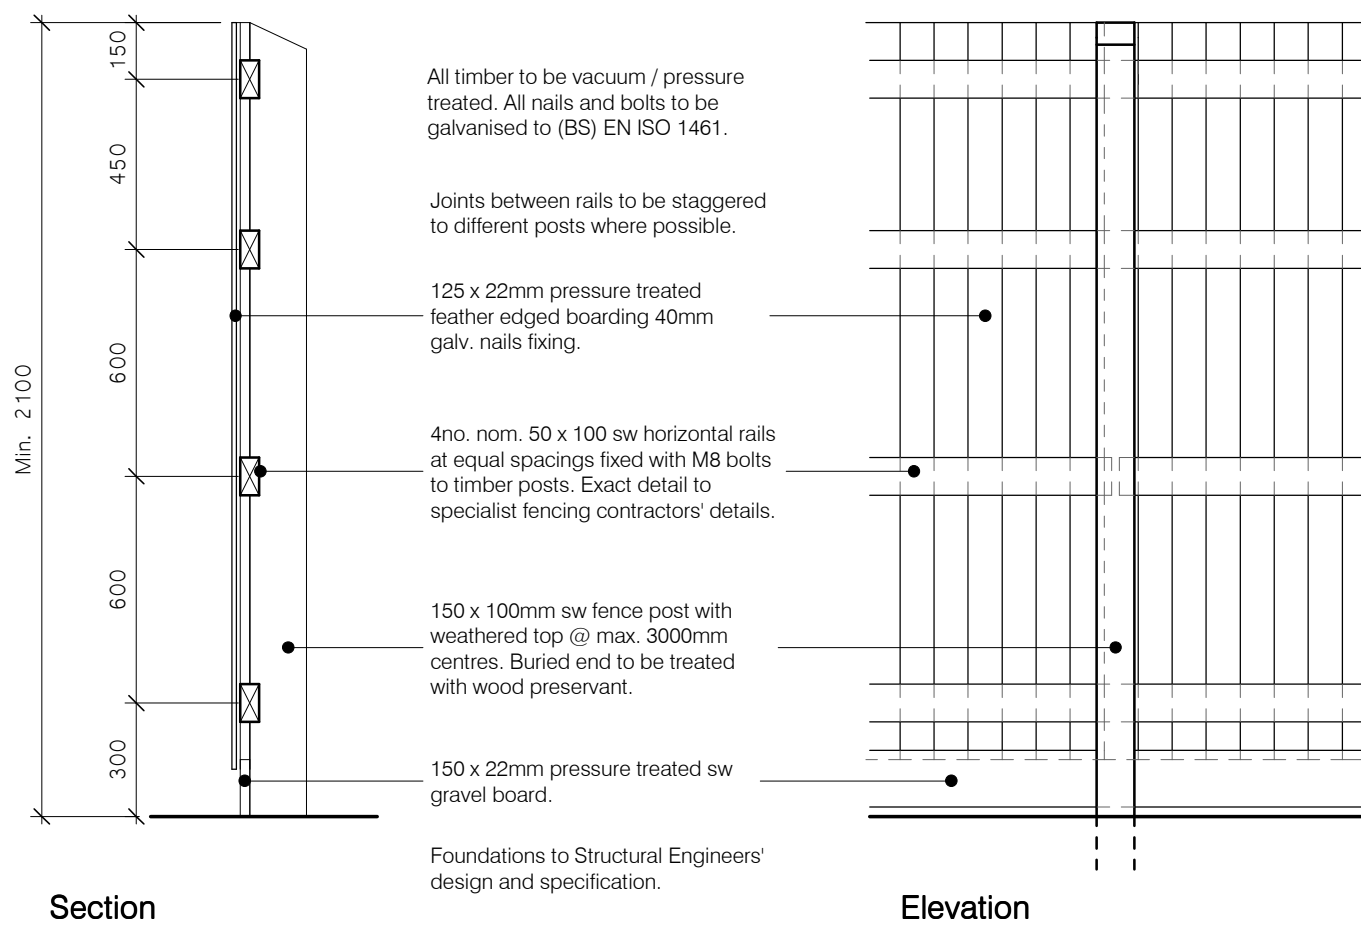

Section

Boundary Type 06

2100mm high close boarded timber fencing.

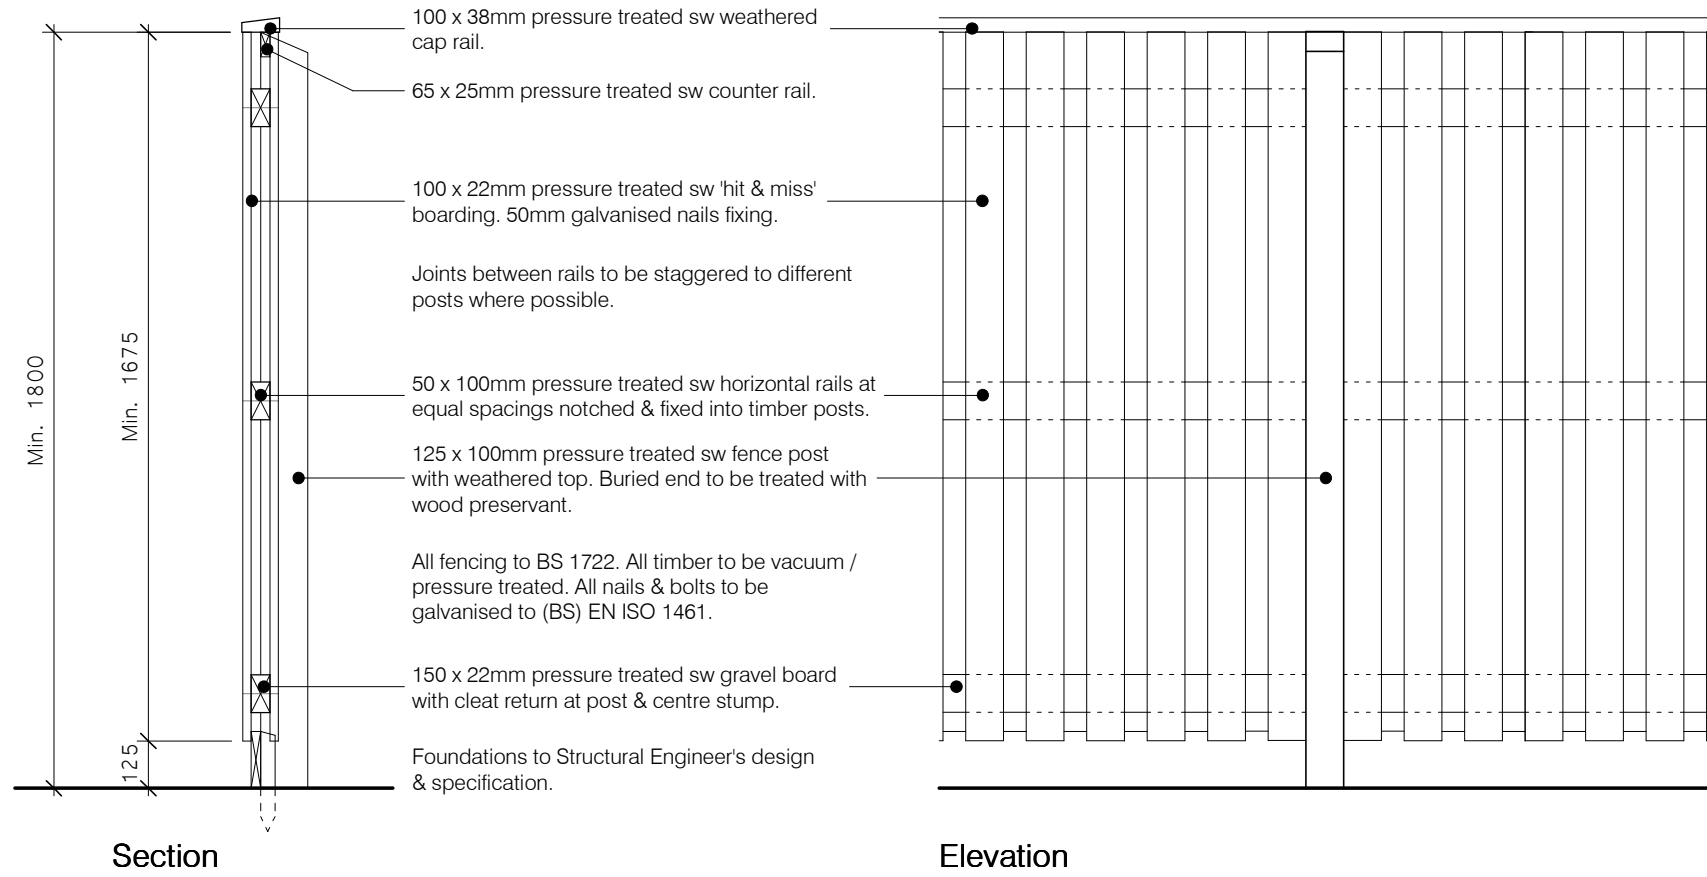

Section

Boundary Type 07

Min. 1800mm high hit and miss timber fencing

Rev.	Description	Drawn	Check	Date
P1	Issued for Approval.			

FOR APPROVAL

pentan
architects

22 Cathedral Road
Cardiff CF11 9LJ
T. 029 2030 9010
info@pentan.co.uk

Project
Llysfaen
Client
Merthyr HA
Drawing Title

Boundary Treatments

Job no.	Org.	Zone	Level	Type	Role	Description	Status	Rev.
4005	PEN	ZZ	ZZ	DR	A	3011	S4	P1
Scale	1 : 20	@ A1						
Date								

Nov 22

NOTES: Do not scale. All dimensions are in millimetres unless stated otherwise