


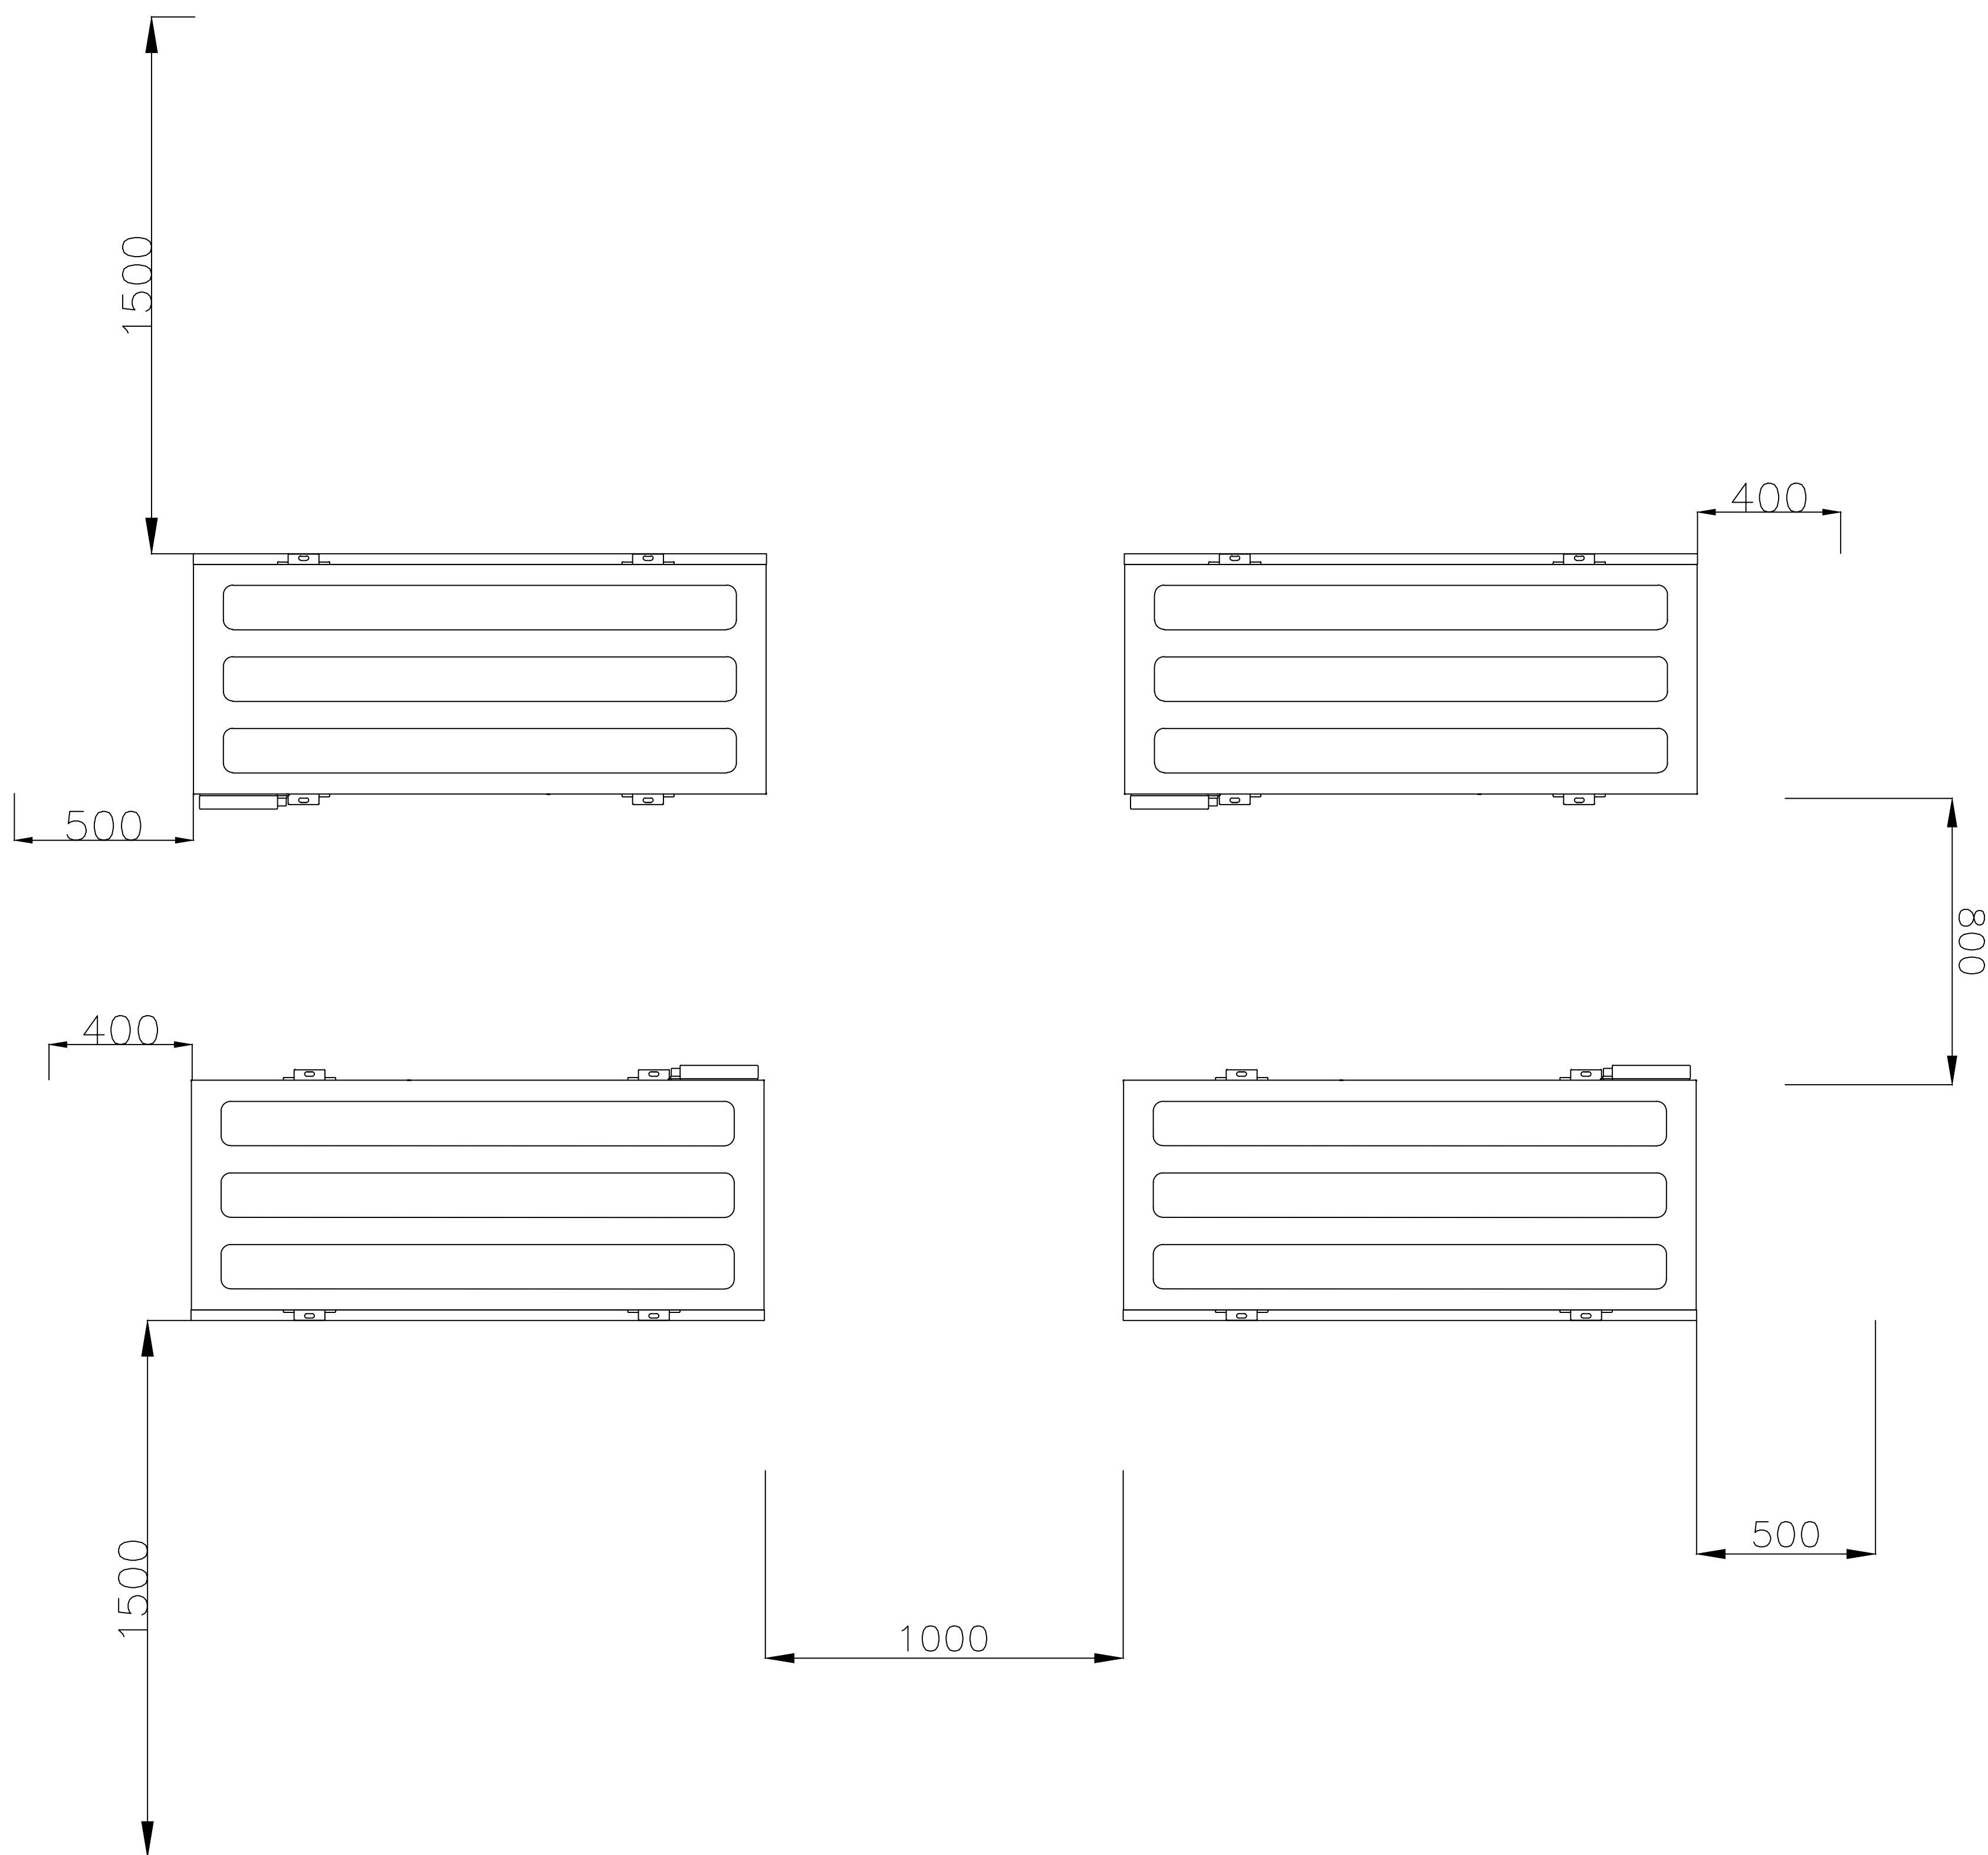

Notes:

Flow

Return

Hot

Cold Main

Lv Cabling

230/440v Cabling

Mechanical key:	
	Pressure switch High Pressure
	Pressure switch Low Pressure
	Pressure&Temperature Gauge
	Temperature Gauge
	Temperature Sensor
	Variable speed pump
	Drain cock
	Relief valve
	Automatic Air vent
	Isolating valve
	Pressure reducing valve
	Lockshield valve
	Commissioning valve
	Automatic bypass valve
	Capped-off filling point
	Motorised 2 ports valve
	Motorised 3 port valve
	Check valve
	Double check valve
	Thermal safety valve
	Line strainer
	Emergency stop
	Orifice test point
	Antifreeze valve
	Outside temperature air sensor

REV:	DESCRIPTION:	BY:	DATE:
STATUS:			

Energy Lab Uk

Unit 1 Coxleigh Barton

Barnstaple

Devon

EX31 4JL

www.energylabuk.com

01271 850 204



CLIENT:


ADDRESS:

TITLE:

i290– Distances

—

SCALE AT A3:	DATE:	DRAWN:	CHECKED:
NTS		Maxi R.	
PROJECT NO:	DRAWING NO:	REVISION:	
	—	—	

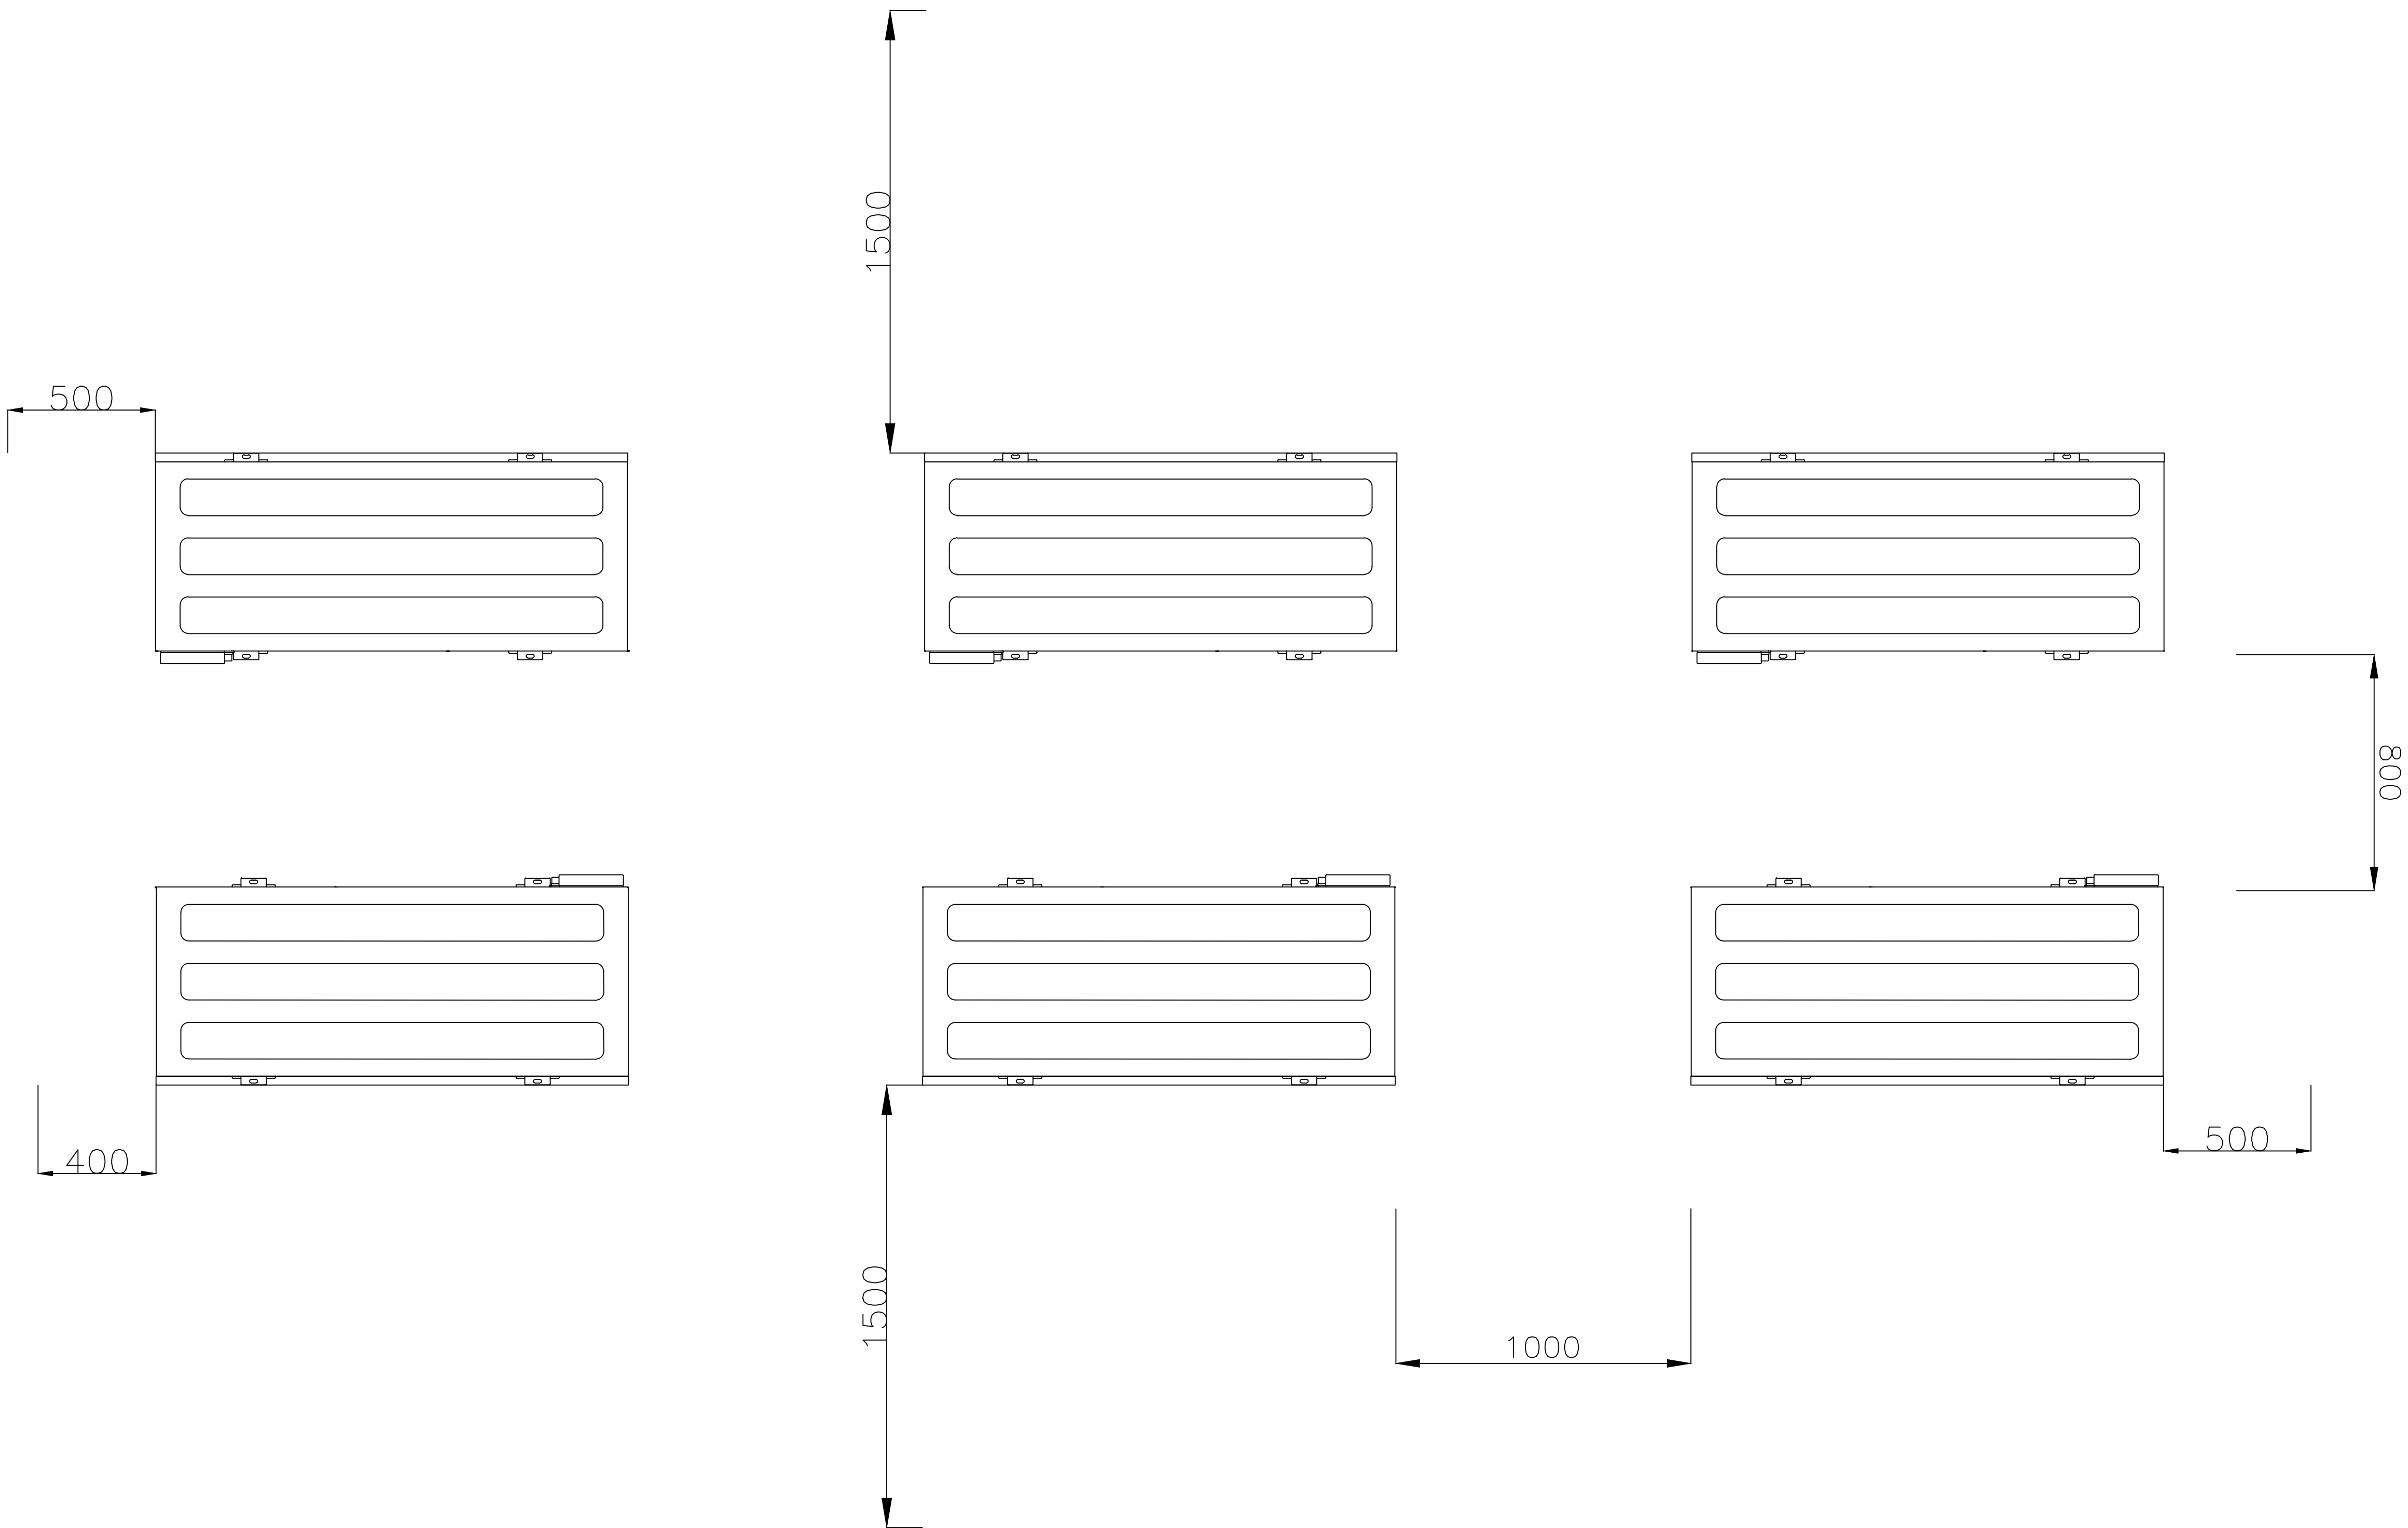

Notes:

Flow

Return

Hot

Cold Main

Lv Cabling

230/440v Cabling

PTHP

PTLP

PT

T

T

Variable speed pump

Drain cock

Relief valve

Automatic Air vent

Isolating valve

Pressure reducing valve

Lockshield valve

Commissioning valve

Automatic bypass valve

Capped-off filling point

Motorised 2 ports valve

Motorised 3 port valve

Check valve

Double check valve

Thermal safety valve

Line strainer

Emergency stop

Orifice test point

Antifreeze valve

Outside temperature air sensor

Mechanical key:

Pressure switch High Pressure

Pressure switch Low Pressure

Pressure&Temperature Gauge

Temperature Gauge

Temperature Sensor

Variable speed pump

Drain cock

Relief valve

Automatic Air vent

Isolating valve

Pressure reducing valve

Lockshield valve

Commissioning valve

Automatic bypass valve

Capped-off filling point

Motorised 2 ports valve

Motorised 3 port valve

Check valve

Double check valve

Thermal safety valve

Line strainer

Emergency stop

Orifice test point

Antifreeze valve

Outside temperature air sensor

REV:	DESCRIPTION:	BY:	DATE:
STATUS:			

Energy Lab Uk
Unit 1 Coxleigh Barton
Barnstaple
Devon
EX31 4JL
www.energylabuk.com 01271 850 204



CLIENT:

ADDRESS:

TITLE:

—

SCALE AT A3:	DATE:	DRAWN:	CHECKED:
NTS		Maxi R.	
PROJECT NO:	DRAWING NO:	REVISION:	
	—	—	