
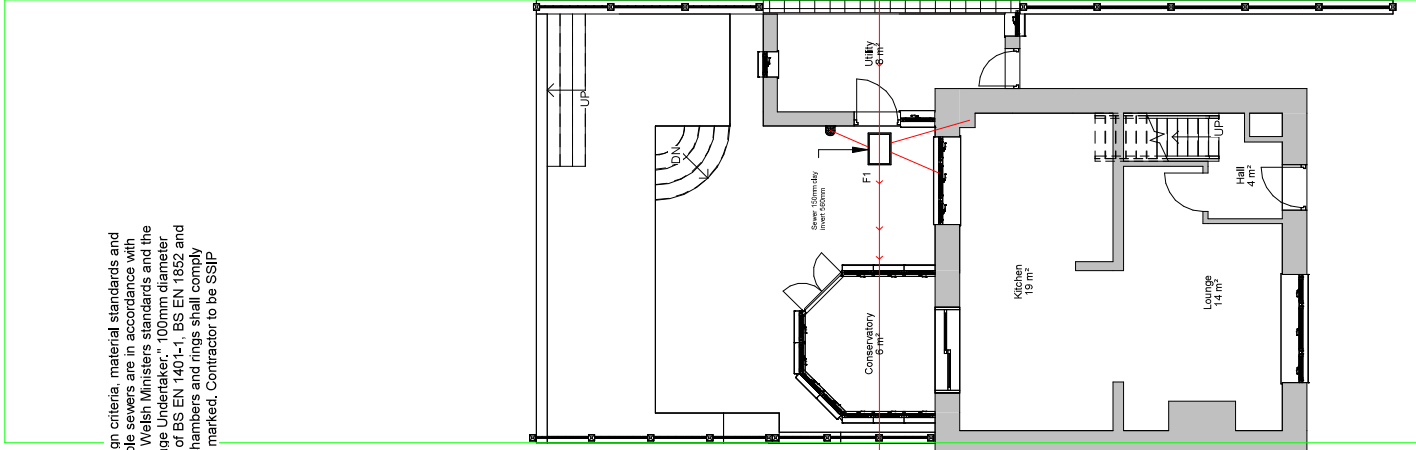



Sewer Protection
New foundations will be a minimum of 150mm below invert level.

NOTE:
"The developer must self-vet and certify that the design criteria, material standards and workmanship specifications for the proposed adoptable sewers are in accordance with those set out in Sewers for Adoption 7th Edition, The Welsh Ministers standards and the requirements of us (DCWW) as the Statutory Sewerage Undertaker." 100mm diameter plastic pipe shall comply with the relevant provisions of BS EN 1401-1, BS EN 1852 and BS EN 12666-1 and be kite marked. Thermoplastic chambers and rings shall comply with BS EN 13598-1 and BS EN 13598-2 and be kite marked. Contractor to be SSIP accredited.

PIPES PASSING THROUGH WALL (LINTEL)

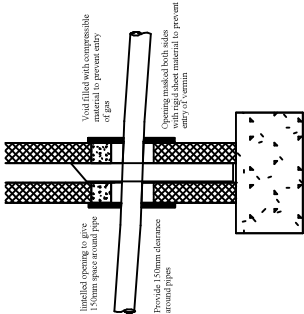

1 Existing Drain Plan
1 : 100

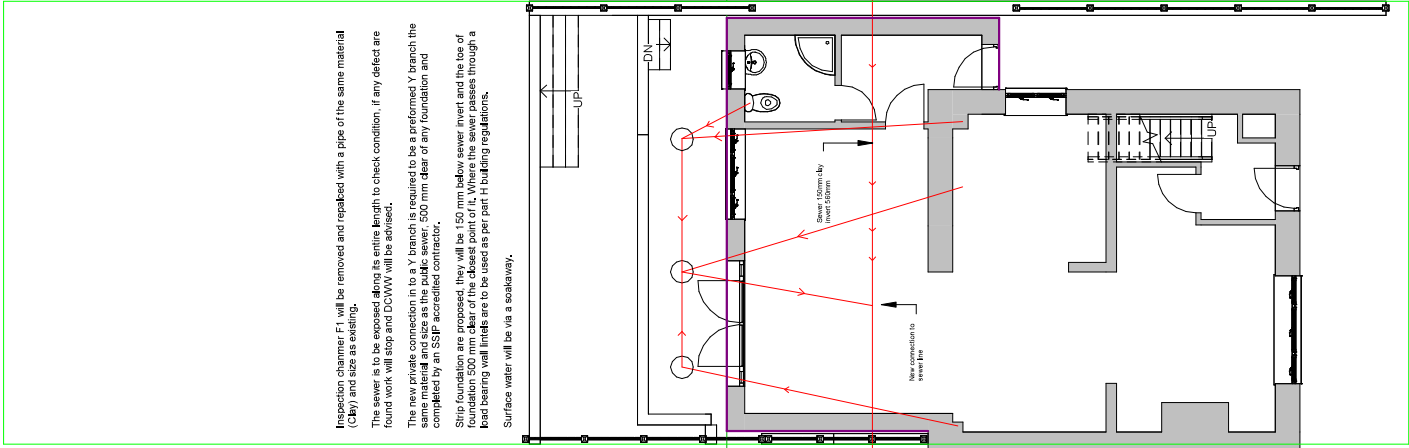

2 Proposed Drain Plan
1 : 100

INDIGO DESIGN (Part of 3dcadwales Ltd) 5 Ashtea Drive, Merthyr Tydfil, CF47 0NY. Tele 01685 385746 Mob - 07949313216 Email: philp@3dcadwales.co.uk		Indigo 3d Design	
This Drawing is Copyright Indigo Design and should not be reproduced on site and not scaled from this drawing		PURPOSE OF ISSUE	DRAWING NUMBER
Planning Approval		GR-06	
PROJECT		Single storey rear extension	
SHEET		Drain Plans	
Address		23 Glasier Road, Merthyr Tydfil, CF47 0TD	
Checked by JH	Drawn by PH	Scale (@ A3) As indicated	
Rev No A	Issue	Description	Date
			25/10/2024