


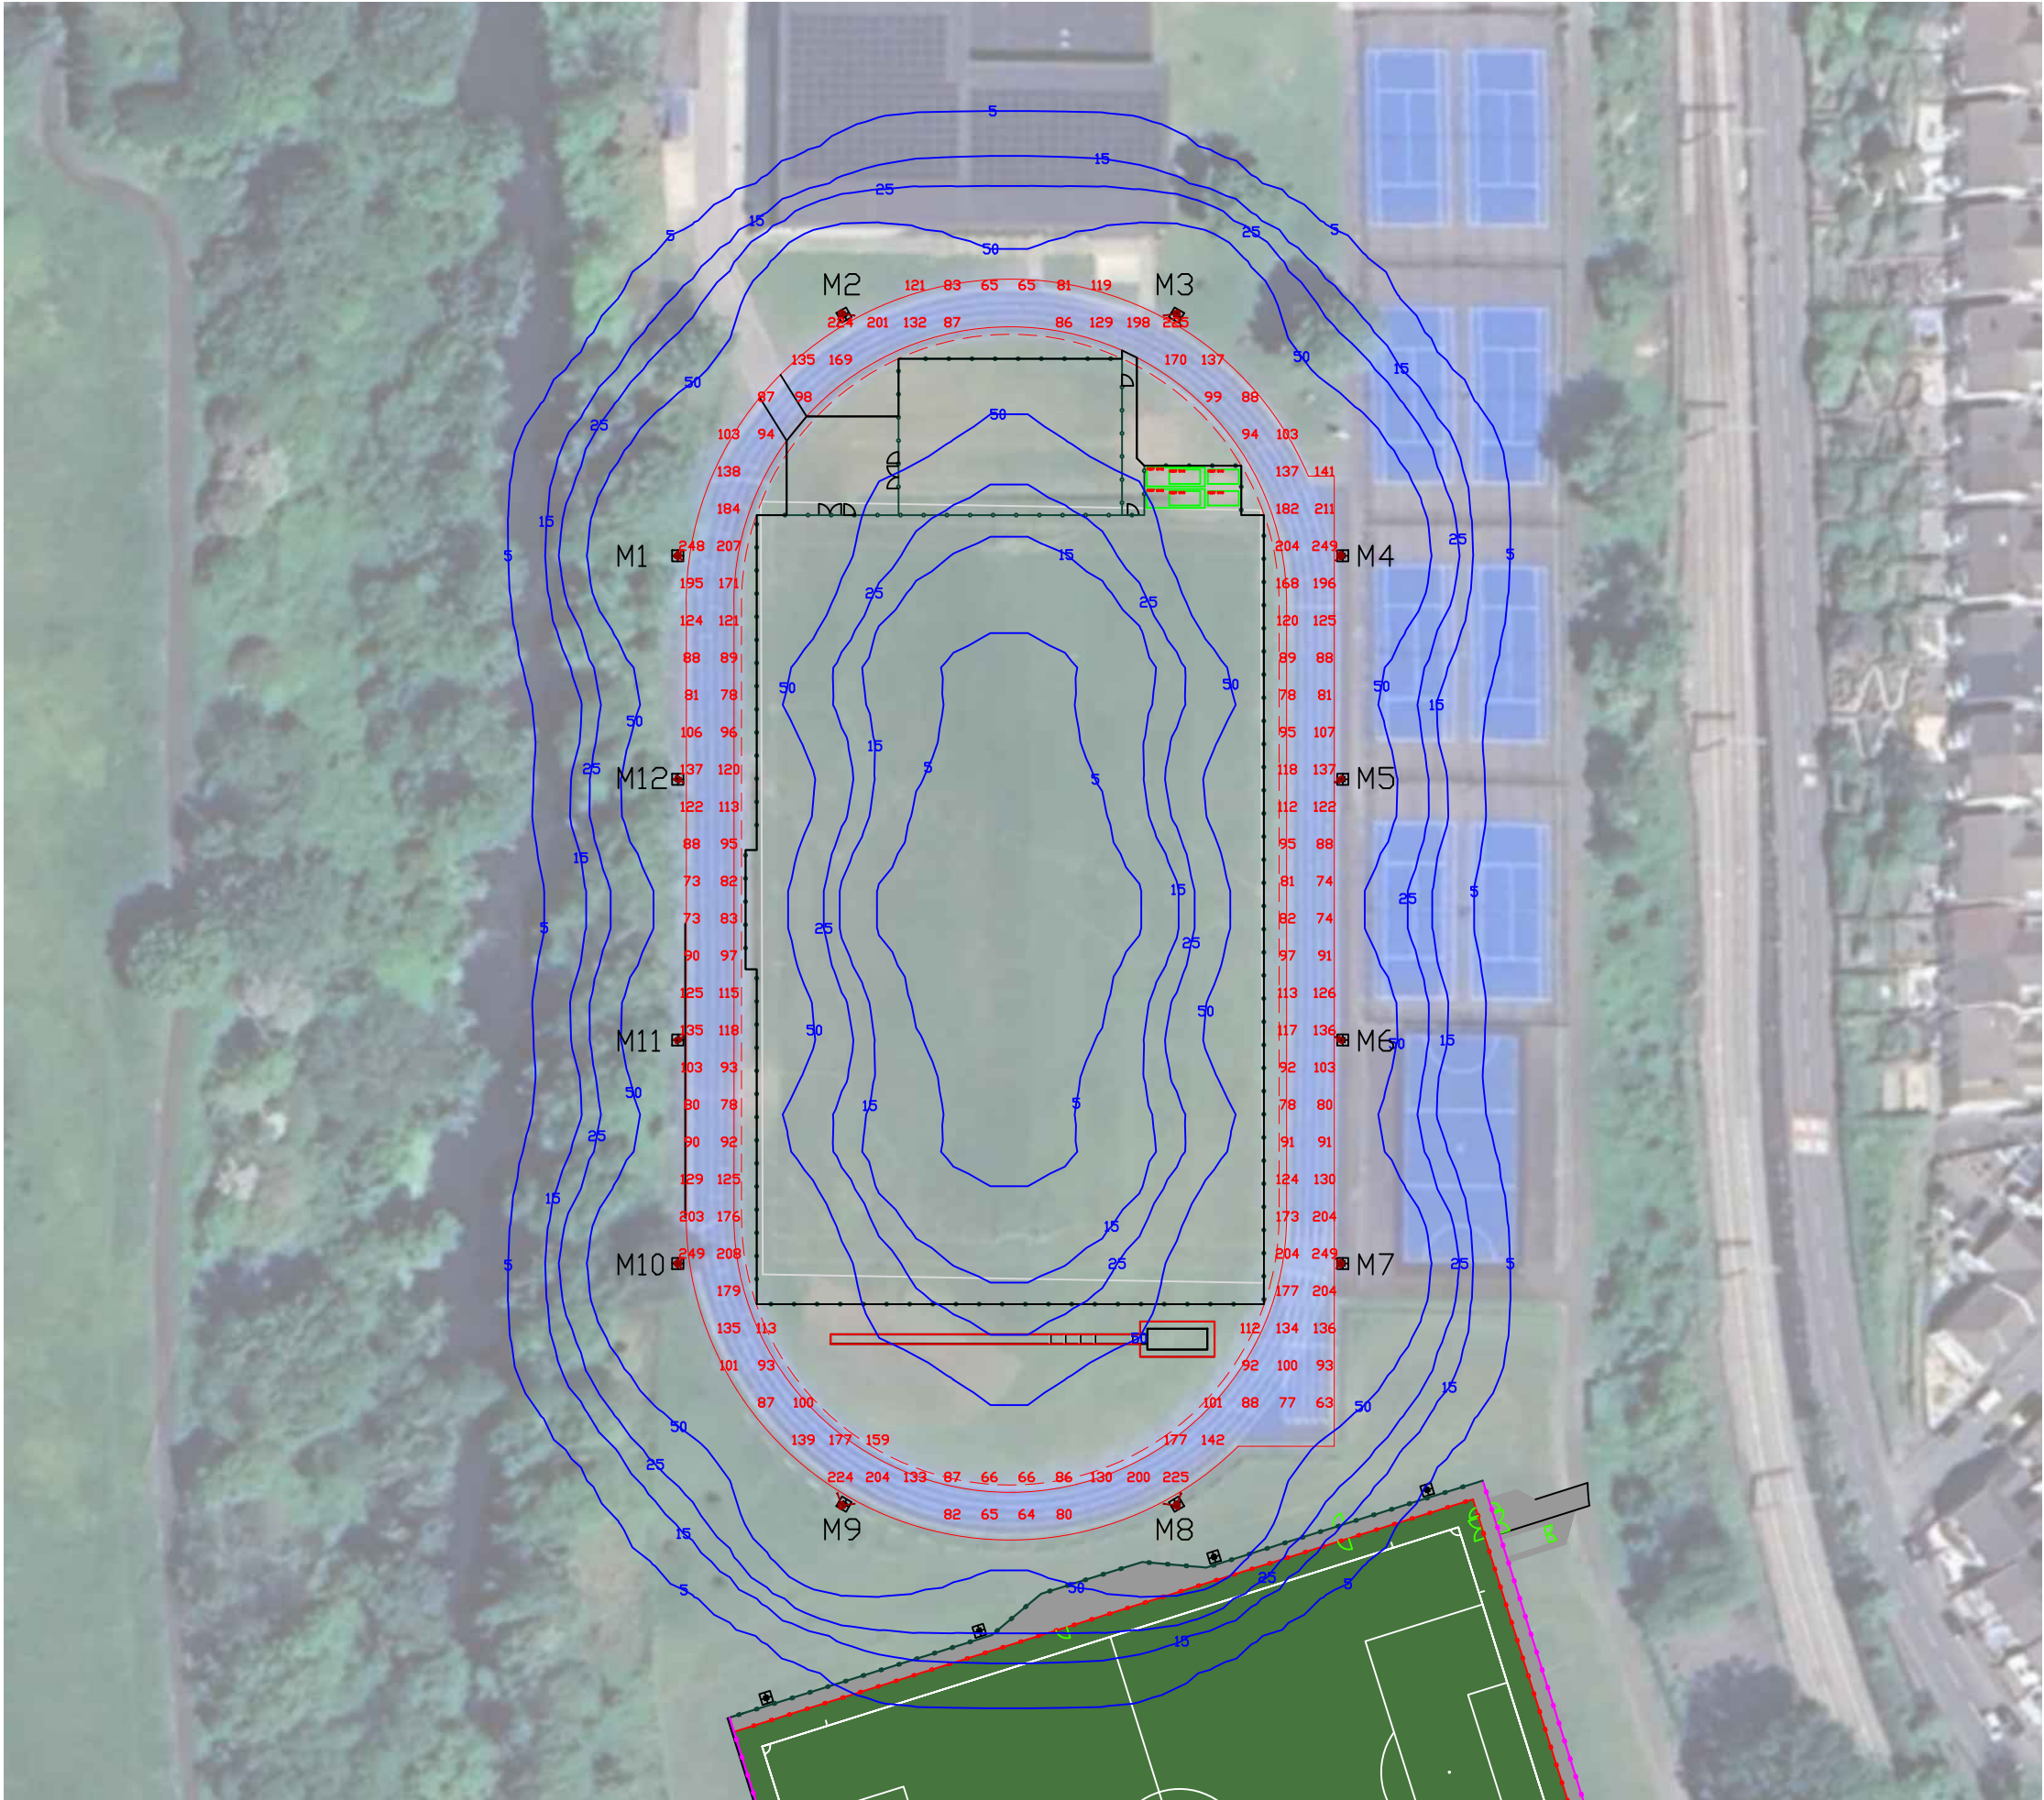

Notes

Floodlighting Equipment
12 x 10m Masts (M1-M12)
Each carrying the following Floodlights :-
M1-M4 & M7-M10
...2 x Siteco SiCompact 31 Maxi PL32
M5, M6, M11 & M12
...1 x Siteco SiCompact 31 Maxi PL32

Siteco LED - 4,000K CRI 70

Illuminance Levels
Initial -
(100hrs) E.i.ave = 124Lux
Maintained -
(50,000hrs) E.i.ave = 112Lux

Uniformity
Emin/Eave = 0.51

Grid values in Lux(initial).
Grid interval = 5m.
Contour values in Lux (initial).
Contours: 5, 15, 25, 50 Lux.

Maintenance Factor = 0.90
(Based on a cleaning interval of 2 years)

EST. 1962 HALLIDAY LIGHTING	
www.halliday-lighting.co.uk	
Project Afon Taf	
Drawing Title Proposed floodlighting	
Drawn By (print) DS	Date 27/02/2024
Project No 7497	Scale NTS
Drawing No HLS7497	Status Proposal