



FDE100VNPWVH

10.0 (2.1 ~ 10.2)

Indoor Unit : FDE100VH

Outdoor Unit : FDC100VNP-W

Specifications

R32

Indoor unit				FDE100VH
Outdoor unit				FDC100VNP-W
Power source				1 Phase 220-240V, 50Hz / 220V, 60Hz
Nominal cooling capacity (Min~Max)			kW	10.0 (2.1 ~ 10.2)
Nominal heating capacity (Min~Max)			kW	10.0 (1.7 ~ 10.4)
Power consumption		Cooling/Heating	kW	3.00 / 2.36
EER/COP		Cooling/Heating		3.33 / 4.24
Inrush current			A	5
Max. running current			A	19
Sound power level*1	Indoor	Cooling/Heating	dB(A)	64 / 64
	Outdoor	Cooling/Heating		68 / 67
Sound pressure level*1	Indoor	Cooling (Hi/Me/Lo/Ulo)		48 / 43 / 38 / 34
		Heating (Hi/Me/Lo/Ulo)		48 / 43 / 38 / 34
	Outdoor	Cooling/Heating		56 / 54
Air flow	Indoor	Cooling (Hi/Me/Lo/Ulo)	m³/min	32 / 26 / 21 / 16.5
		Heating (Hi/Me/Lo/Ulo)		32 / 26 / 21 / 16.5
	Outdoor	Cooling/Heating		63 / 55
Exterior Dimensions	Indoor	Height x Width x Depth	mm	250 x 1,620 x 690
	Outdoor			750 x 880(+88) x 340
Net weight	Indoor / Outdoor		kg	43 / 57
Refrigerant		Type/GWP		R32/675
Refrigerant		Charge	kg/TCO2Eq	1.7/1.148
Refrigerant piping size		Liquid/Gas	ø mm	6.35(1/4") / 15.88(5/8")
Refrigerant line (one way) length			m	Max.30
Vertical height differences		Outdoor is higher/lower	m	Max.20 / Max.20
Outdoor operating temperature range	Cooling*2		°C	-15~46
	Heating			-15~20
Air filter quantity				Pocket Plastic net x2(Washable)
Remote control (option)				wired:RC-EX3A, RC-E5, RCH-E3 wireless:RCN-E-E3
Energy Class (Cooling/Heating)				A+ +/A+
SEER				6.63
SCOP (Average climate)				4.24
Pdesign (cooling/heating(@-10°C))			kW	10.0/6.0
Annual Electricity Consumption (cooling/heating)			kWh/a	529/1984
Designated Heating Season				Average

The data is measured under the following conditions(ISO-T1).


Cooling: Indoor temp. of 27°CDB, 19°CWB, and outdoor temp. of 35°CDB. Heating: Indoor temp. of 20°CDB, and outdoor temp. of 7°CDB, 6°CWB.

*1 : Indicates the value in an anechoic chamber. During operation these values are somewhat higher due to ambient conditions.


*2 : If a cooling operation is conducted when the outdoor air temperature is -5°C or lower, the outdoor unit should be installed at a place where it is not influenced by natural wind. If wind blows, the low pressure will drop and compressor frequency will increase, this will cause the capacity to drop and may cause the unit to break down.

Schematics

Note (1) The model name label is attached on the fan casing inside the air return grille.

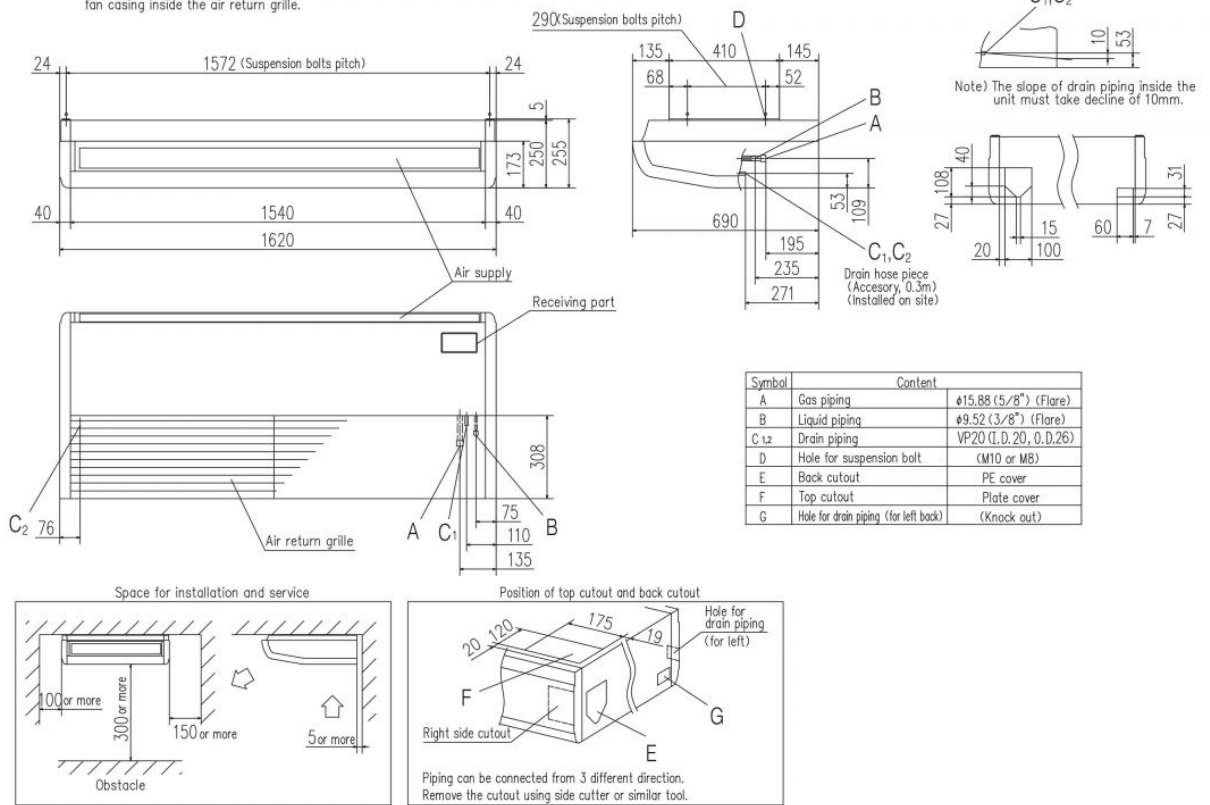


FDC90VNP1

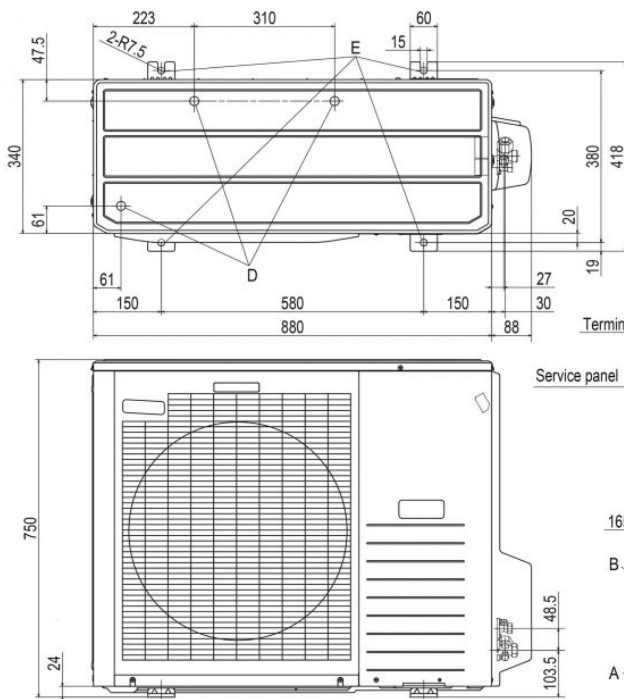

Notes

- (1) It must not be surrounded by walls on four sides.
- (2) The unit must be fixed with anchor bolts. An anchor bolt must not protrude more than 15mm.
- (3) Where the unit is subjected to strong winds, lay it in such a direction that the blower outlet faces perpendicularly to the dominant wind direction.
- (4) Leave 1m or more space above the unit.
- (5) A wall in front of the blower outlet must not exceed the unit's height.
- (6) The model name label is attached on the lower right corner of the front panel.

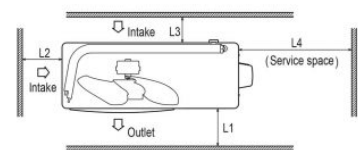

Minimum installation space

Examples of installation	I	II	III
L1	Open	Open	500
L2	300	250	Open
L3	100	150	100
L4	250	250	250

Symbol	Content
A	Service valve connection (gas side)
B	Service valve connection (liquid side)
C	Pipe / cable draw-out hole
D	Drain discharge hole
E	Anchor bolt hole