




PIPE SCHEDULE		
REF.	PIPE DIA.	REQUIREMENTS
P1.0	150mm	
P1.1	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.2	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.3	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.4	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.5	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.6	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.7	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.8	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.9	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.10	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.11	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P1.12	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P2.0	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P2.1	150mm	
P2.2	150mm	
P2.3	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P2.4	225mm	Perforated pipe within filer drain 0.5m (w) x 1m (d)
P2.5	150mm	
P2.6	150mm	
P2.7	150mm	
P2.8	150mm	

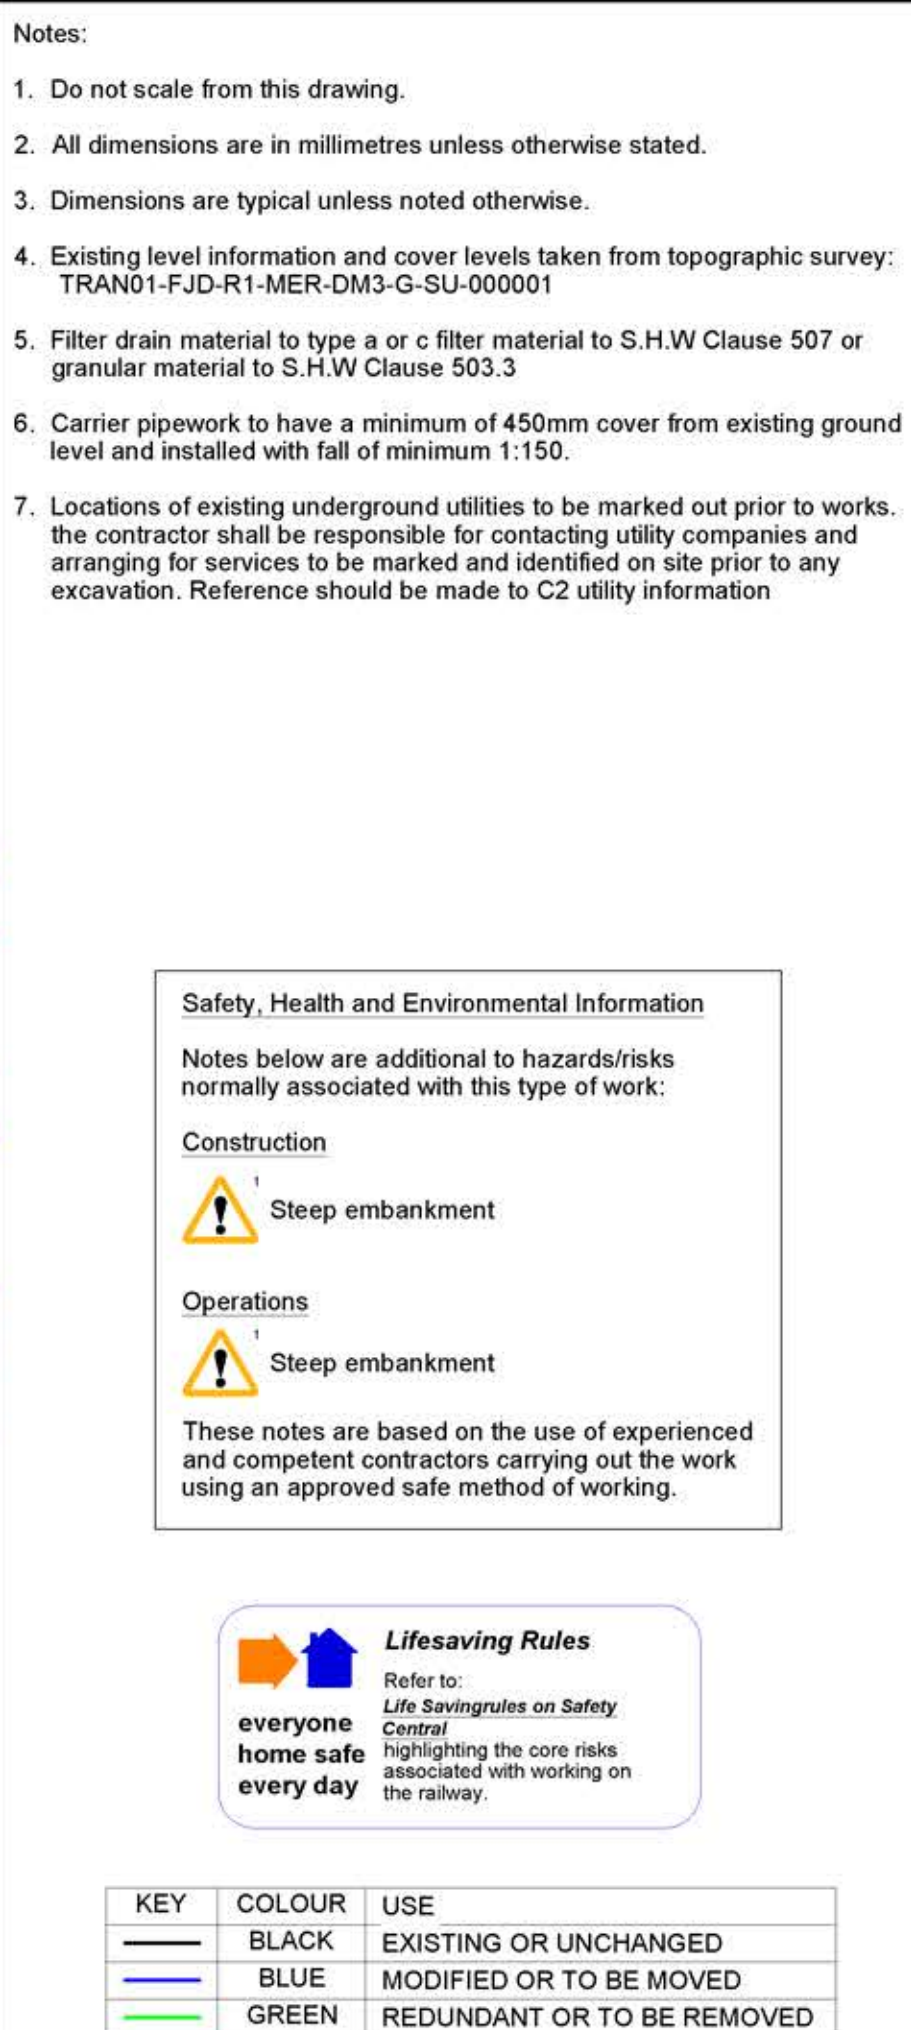