


Sewer Protection
New foundations will be a minimum of 150mm below invert level.

NOTE: The developer must self-vet and certify that the design criteria, material standards and workmanship specifications for the proposed adoptable sewers are in accordance with those set out in Sewers for Adoption 7th Edition, The Welsh Ministers standards and the ODCW as the Statutory Sewerage Undertaker. 100mm diameter plastic pipe shall comply with the relevant provisions of BS EN 1401-1, BS EN 1632 and BS EN 16398-1 and be marked accordingly. The pipe must be marked in accordance with BS EN 13598-1 and BS EN 13598-2 and be kitemarked. Contractor to be SSIP accredited.

[illegible]

INDIGO DESIGN (Part of 3dcaadwales Ltd) 5 Asilake Drive, Merthyr Tydfil, CF47 0NY Tele 01890 385746 Mob - 07940813216 Email: info@3dcaadwales.co.uk			
This Drawing is Copyright, Dimensions to be checked on site and not based from this drawing		PURPOSE OF ISSUE	DRAWING NUMBER
Planning Approval		CS-06	
PROJECT	Two storey rear extension		
SHEET			
Proposed Drain Plan			
7 Castle Square, Merthyr Tydfil, CF47 8NU			
Address		Checked by JH	Drawn by PH
Scale (@ A3) As indicated		Date 17/03/2025	
Rev/No A	Description	Issue	

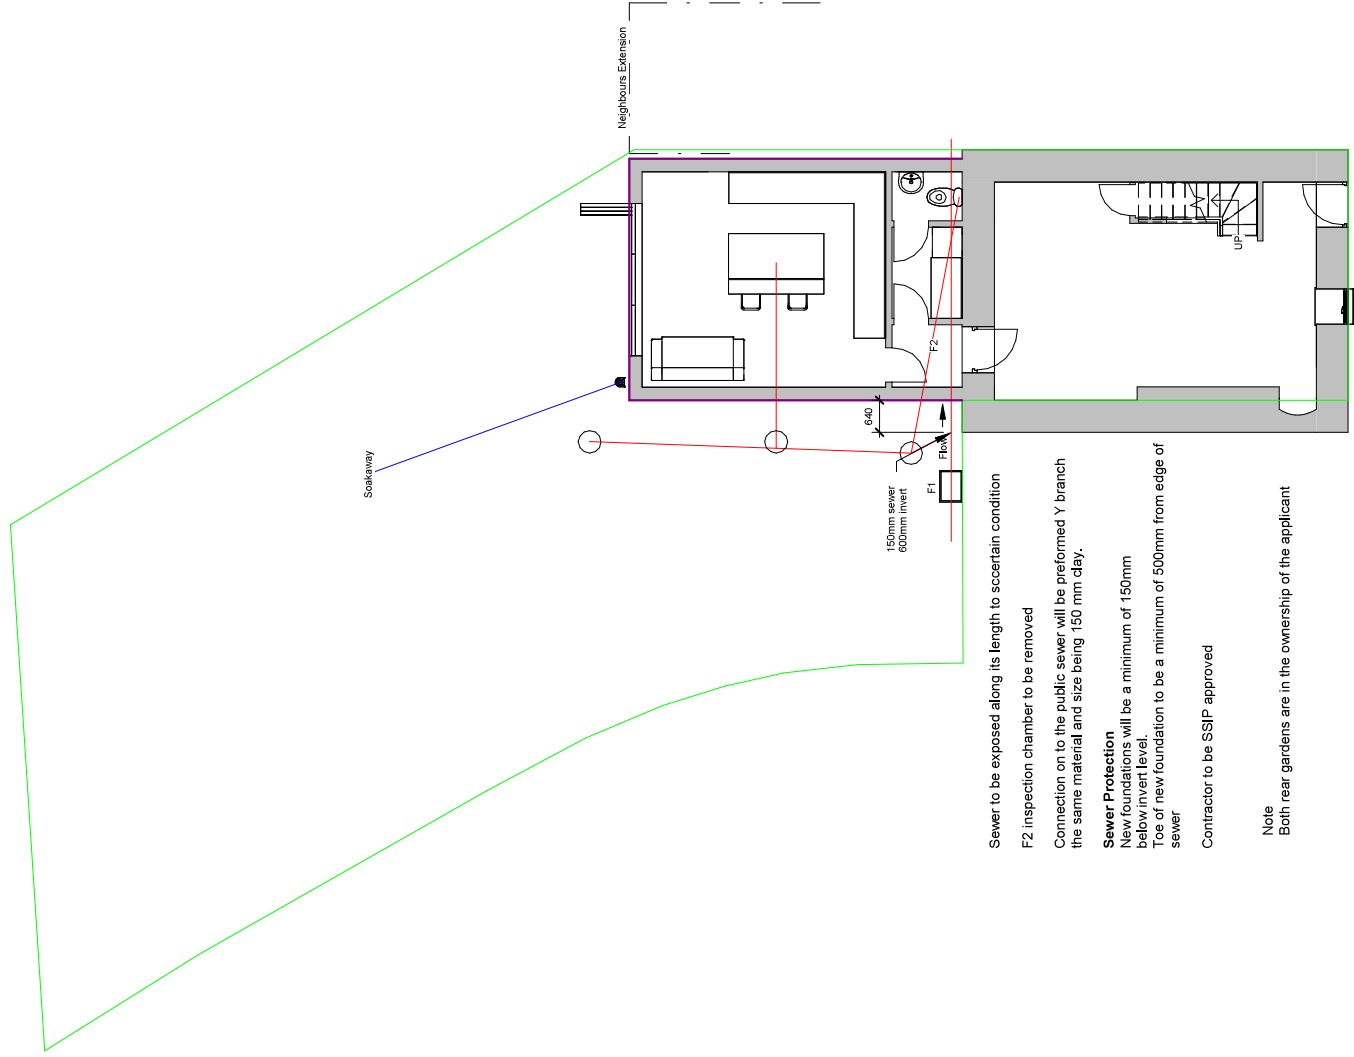

Note
Both rear gardens are in the ownership of the applicant

1 Proposed Drain Plan
1 : 100