


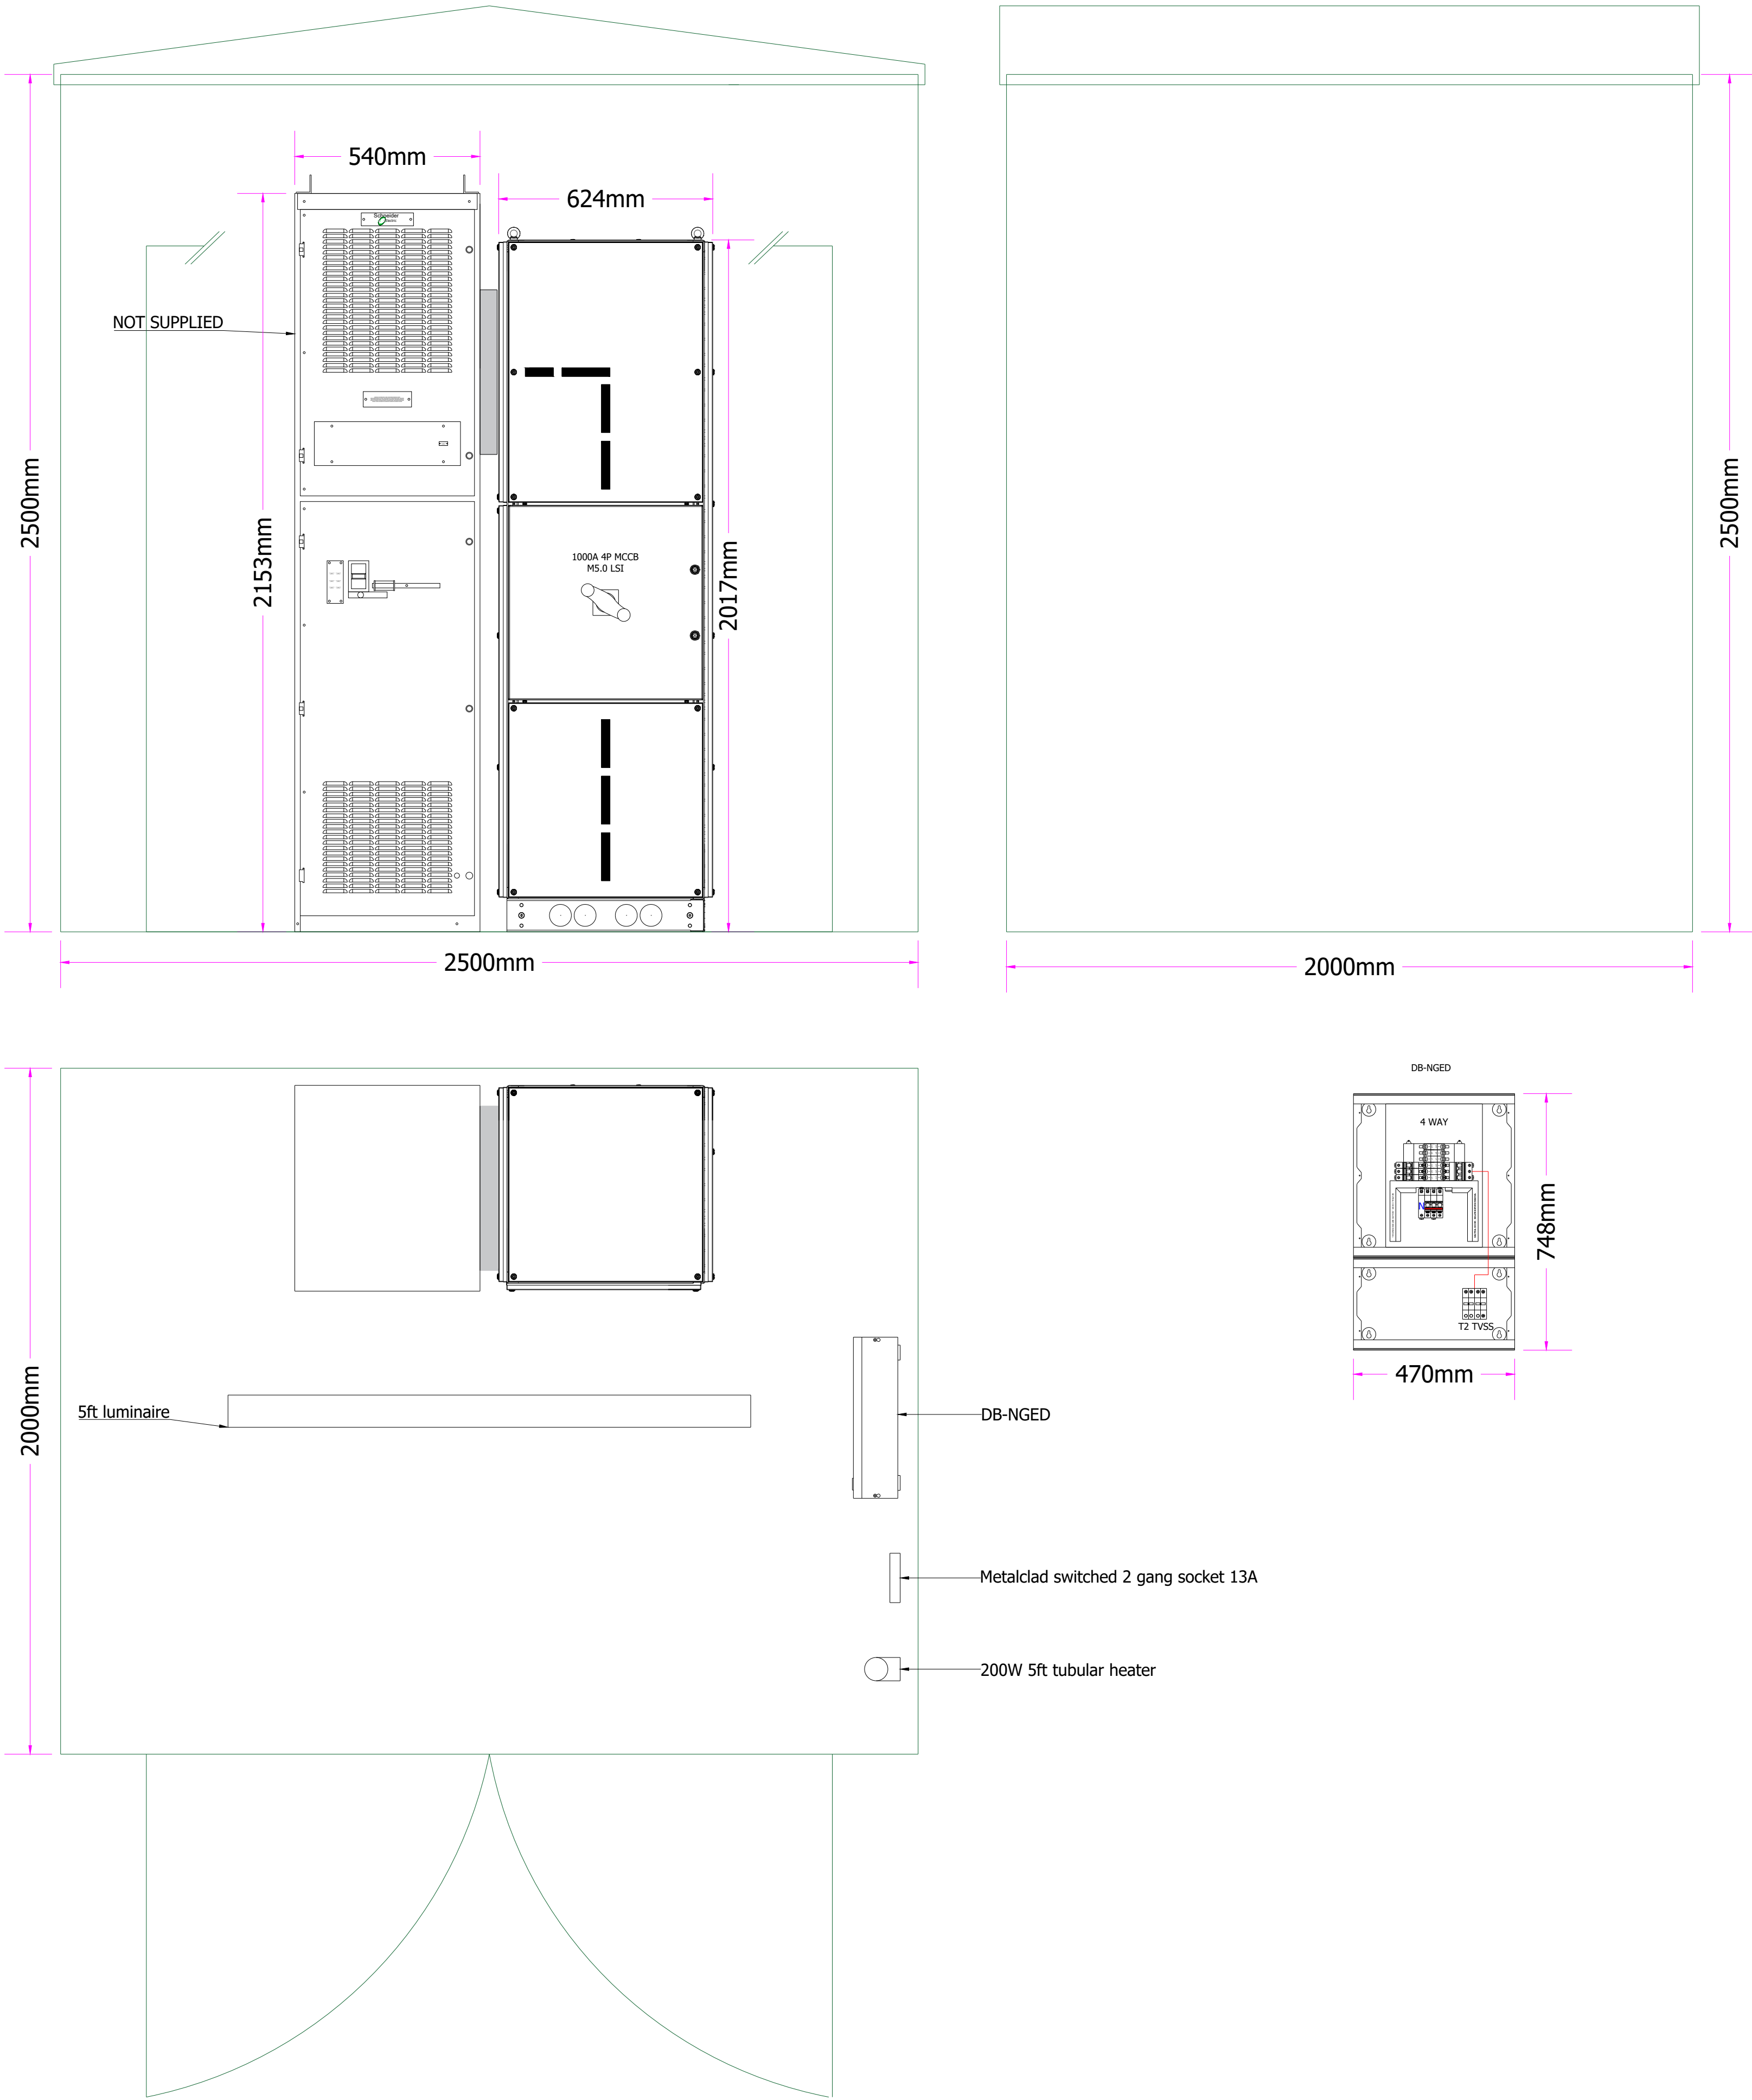

PROJECT INFORMATION	
PROJECT:	Goetre Primary School
CLIENT:	MITIE
PROJECT DESCRIPTION:	Isolator Panel & GRP
SHEET DESCRIPTION:	GENERAL ARRANGEMENT EXTERNAL
GENERAL SPECIFICATION	
ACCESS REQUIRED FOR CABLING:	FRONT
INCOMING CABLES:	LEFT SIDE TOP
OUTGOING CABLES:	TOP/BOTTOM
BUSBAR RATING:	1250A
FAULT RATING CAPACITY:	50KA 1s
FORM OF CONSTRUCTION:	FORM 4 type 6
INGRESS PROTECTION:	IP3X
SYSTEM:	400V 3PH 4 WIRE
PAINT COLOUR:	RAL7035
NOTES	
Revision C: - Up-rated MCCB to 1000A - Up-rated busbars to 1250A	
CLIENT APPROVAL	
SIGNATURE:	
DATE:	
DESIGN INFORMATION	
DESIGNED BY:	J. BREWER
QUOTED BY:	J. BREWER
CHECKED BY:	--
DATE ISSUED:	04/07/2025
PAPER SIZE:	A1
SCALE:	NTS
HAC REFERENCES	
DRAWING REF:	HAC-0820361.1.01-INTAKE
QUOTE REF:	Q.0829072.2.01-H
PROJECT REF:	N/A
ORDER REF:	N/A
REVISION:	C
SHEET:	001 OF 001
HAC HARRIES AUTOMATION & CONTROL LTD. SYSTEMS HOUSE TROSTRE BUSINESS PARK LLANELLI CARMARTHENSHIRE SA14 9UU TEL: +44 (0) 1554 777460 WEB: www.harriesautomation.com	