


FOUNDATION BLOCK A

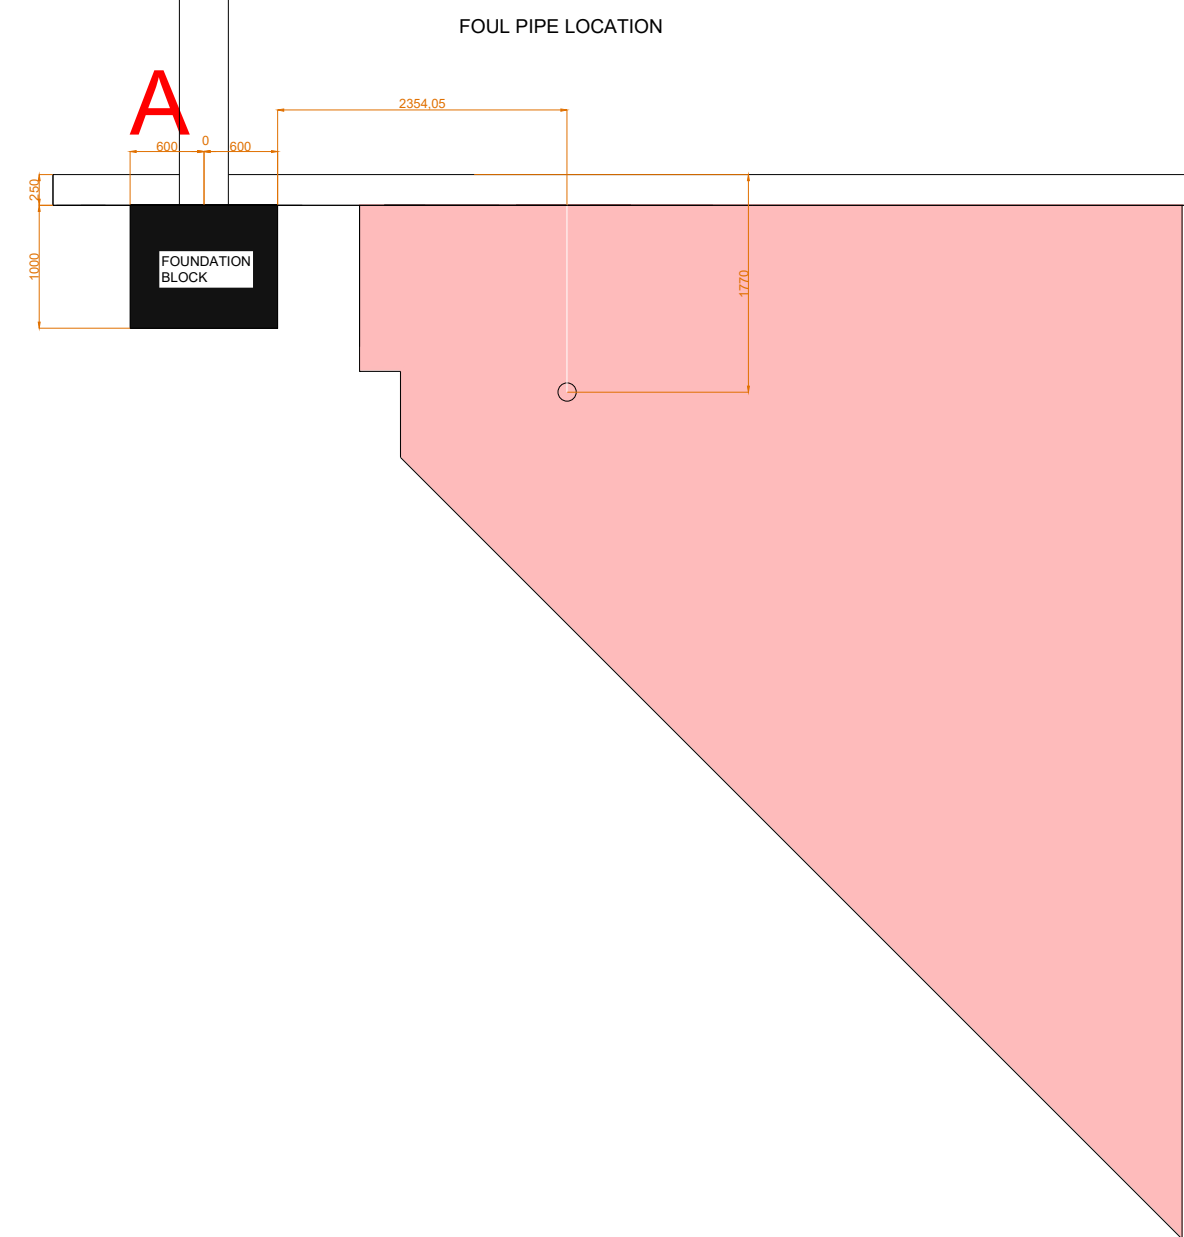

FOUNDATION / SEWER PROTECTION

The shaded region illustrates the allowable location and depth of the foul sewer, determined using the 45° rule relative to the proposed foundations.

The indicated sewer location and invert depth fall within this allowable region, demonstrating that the proposed foundations are outside the sewer's zone of influence.

The minimum horizontal separations between the proposed foundations and the indicated sewer centreline are approximately 2,354 mm at Foundation Block A and 1,819 mm at Foundation Block C.

