


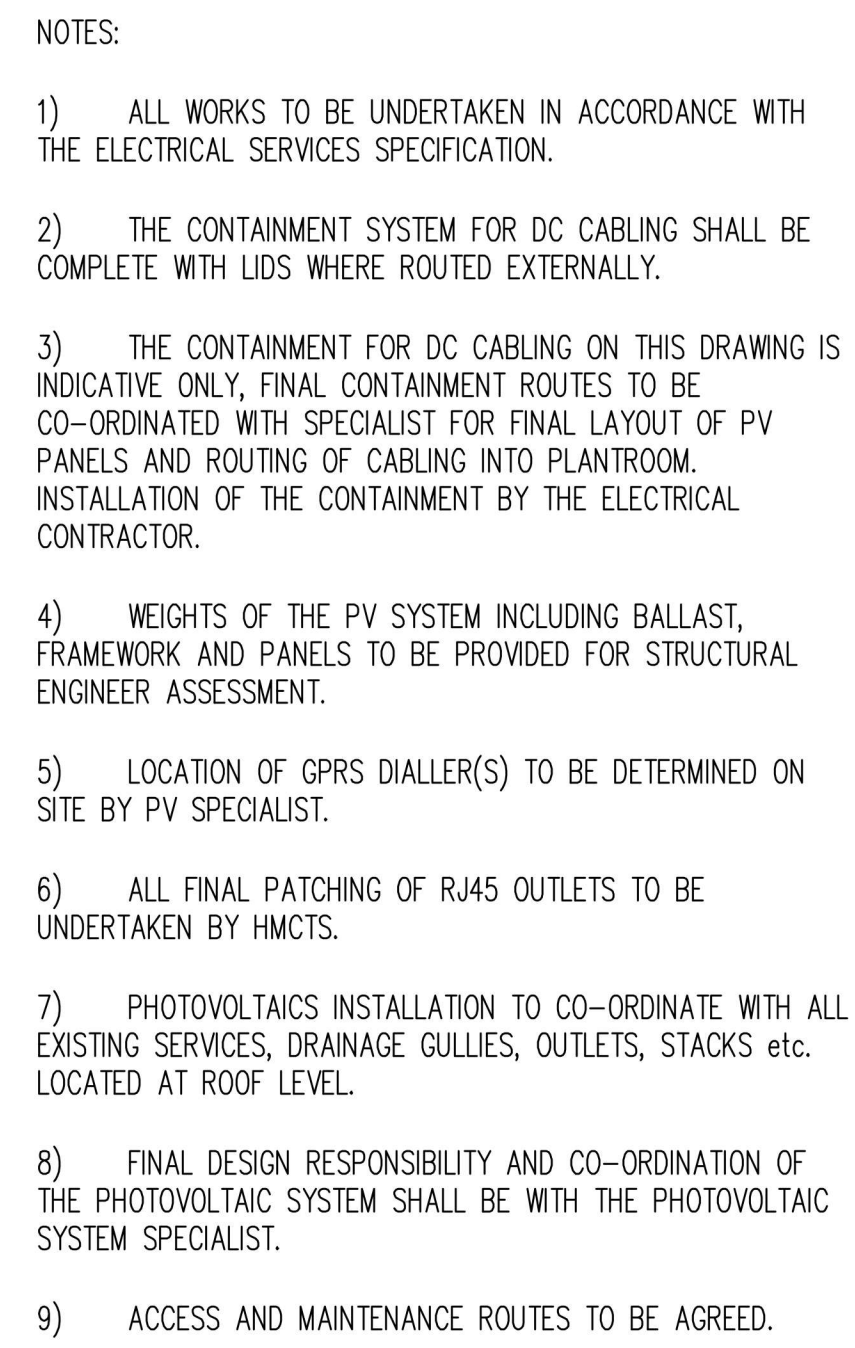

- | | |
|---|---|
|  | SUB-MAIN CABLE
CABLE LADDER |
|  | PV DC CABLE TRAY + LID |
|  | DATA/ELV CABLE BASKET |
|  | PHOTOVOLTAILC
INVERTER AND DC
ISOLATION |
|  | EARTH BAR |
|  | 250A TYPE B
DISTRIBUTION BOARD |
|  | 200A FUSED SWITCH
DISCONNECTOR |
|  | TWIN RJ45 DATA OUTLET |

AMENDMENTS	DATE
03 - UPDATED TO PROPOSED 75KW PV SYSTEM REQUIREMENTS	27/10/23
02 - REMOVED BATTERY STORAGE	20/09/23
01 - CONSTRUCTION ISSUE	08/09/23